


**AECOM**

**WILSON  
MEANY**




D & D ENGINEERING, INC.

**Inglewood Basketball &  
Entertainment Center  
Project  
LOW IMPACT DEVELOPMENT  
(LID) REPORT  
August 23, 2018**

D & D Engineering, Inc.  
8901 S. La Cienega Blvd.  
Inglewood, CA 90301  
424-351-6800





**Table of Contents**

**I. Introduction** .....2

**II. Project Description** .....2

**a. Existing Conditions** .....2

**b. Proposed Conditions** .....2

**III. Low Impact Development (LID) Stormwater Quality Control Measures** .....3

**a. Los Angeles County Design Guidelines** .....3

**b. Proposed Low Impact Development (LID) System** .....3

**IV. Hydromodification Analysis** .....4

**V. Site Design BMPs** .....4

**a. Site Design** .....4

**b. BMP Selection** .....5

**VI. Summary and Conclusion** .....6

**VII. References** .....6

**TABLES:**

Table 1 - Post-Development Conditions

**FIGURES:**

*Figure 1 — Vicinity Map*

*Figure 2 – Conceptual Low Impact Development (LID) Exhibit*

*Figure 3 — Site Specific Bio-Filtration Details*

**APPENDICES:**

*Appendix A — Excerpt from Geotechnical Report*

*Appendix B — Post-Development Hydrological Conditions*

*Appendix C — Bio-Filtration Sizing Calculations*

## **I. Introduction**

The purpose of this report is to outline and describe the proposed Low Impact Development (LID) strategies and Best Management Practices (BMPs) necessary to adequately reduce the hydrological and environmental impact of developing the proposed project, Project Condor, to comply with the requirements of LID Ordinance and LID Standard Manual<sup>1</sup>. Additionally, this report will determine the storm water quality design volume (SWQDV) calculated from the 85<sup>th</sup> percentile, 24-hour rain event that is required to be treated. Finally, this report will also discuss the methodology used to arrive at these conclusions, the infrastructure necessary to support it and the operations and maintenance procedures required to maintain the system effective over time.

## **II. Project Description**

Project Condor is comprised of three sites located near the intersection of Century Boulevard and Doty Avenue in the city of Inglewood. The first and main project site is located to the southwest of the intersection the second parcel is located to the southeast of the intersection, and the third piece is southwest of Century and Prairie intersection. The first site of the proposed development includes a multi-purpose sport arena, a parking structure and other miscellaneous use buildings. The site is located on an approximately 17-acre site bound by Century Blvd. on the North, Prairie Avenue on the West, Doty Avenue on the East and 103th Street on the South. The second site includes proposed surface parking over an approximately 5-acre parcel, not contiguous to the main project site, just east of Doty Avenue. The third site includes proposed surface parking over an approximately 5.5 acre parcel, not contiguous to the main project site, just west of Prairie Avenue north and south of existing W 101st street. to the project vicinity map, *Figure 1 — Vicinity Map*, for project site location.

Project Condor is a mixed-use project that includes a multi-purpose sport arena with auxiliary structures including retail, office buildings, restaurants, parking structures and plaza areas. The project consists of 71,000 sq. ft. of office space, 25,000 sq. ft. of retail space, 15,000 sq. ft. of food services, 85,000 sq. ft. of practice facilities, 25,000 sq. ft. of Sports Medicine Clinic. 15,000 sq. ft. of Community Space, an 18,000-seat arena, a parking structure and substantial surface parking.

### **a. Existing Conditions**

The existing site over the proposed main project site currently contains commercial buildings, a hotel, a fast-food restaurant and significant portions of vacant land. The existing site over the proposed surface parking site consists of five parcels that are currently all vacant. The existing site over the proposed surface parking west of Prairie Avenue site consists of thirty parcels that are currently all vacant.


Preliminary geotechnical investigations indicate that infiltration is infeasible for the site. The native soil characteristics are generally draining poorly and mostly heavily clayey or silty with an infiltration rate less than the LA County minimum for infiltration of 0.3 in/hr. Refer to the geotechnical report and recommendations, *Appendix A — Excerpt from Geotechnical Report*, for a summary of geotechnical findings.

### **b. Proposed Conditions**

The proposed project seeks to develop the site into a mixed-use development composed of three general sites. The main site is considered the event area and includes a multi-purpose sports arena, retail/commercial buildings, a parking structure, and outdoor plaza. The east site proposes a parking structure, while the west site proposes surface

---

<sup>1</sup> (County of Los Angeles Department of Public Works, 2014)



parking lots. Due to these improvements, it is estimated that approximately 90% of the project site will be covered by impervious surfaces.

### **III. Low Impact Development (LID) Stormwater Quality Control Measures**

The Low Impact Development (LID) plan is intended to mitigate the hydrological and environmental stresses imposed on the site due to its proposed development. As the site's development typically increases impervious level, so does the stormwater runoff volume and the amount of environmental pollutant it produces. The goal of the LID plan is to mitigate these factors by both reducing the volume of stormwater and potential pollutants in stormwater runoff to the most reasonable extent possible. This strategy may be accomplished by implementing a variety of Best Management Practices (BMPs) stormwater quality control measures designed to handle the frequent, smaller storm event, or the initial volume of stormwater run-off from a larger storm event (referred as first flush). This study will focus on and follow the procedures for selecting and implementing stormwater quality measures, as recommended in the Los Angeles County Department of Public Works (LACDPW) Low Impact Development Standards Manual.

#### **a. Los Angeles County Design Guidelines**

The focus of the design criteria for stormwater control measures is the construction and implementation of stormwater quality control measures that meet stormwater runoff requirements in terms of on-site retention and pollutant removal. The project must design and implement stormwater quality control measures that can handle the SWQDv. Any surplus storm run-off must be diverted around the stormwater quality control measures to prevent overloading. The Los Angeles County Department of Public Works Low Impact Development Standards Manual categorized stormwater control quality measures into the following types listed in level of priority:

1. Retention based BMPs (bioretention, infiltration basin, drywells, capture and reuse cisterns, green roof)
2. Biofiltration BMPs (biofiltration)
3. Vegetation-based BMPs (stormwater planters, vegetated swales, tree-well filter, etc.)
4. Treatment-based BMPs (Extended detention basin, constructed wetlands, wet pond, sand filters, proprietary devices)

Systems in a lower priority level may only be used if higher priority measures are deemed to be technically infeasible as set forth in the county's standards manual. Due to the properties of the native soils and the tendency to percolate well, this study will focus on retention-based BMPs.

#### **b. Proposed Low Impact Development (LID) System**

The proposed Low Impact Development (LID) system will utilize a combination of county standard bio-filtration planters and proprietary bio-filtration systems by Contech to treat the SWQDv from the 85<sup>th</sup> percentile, 24-hour storm. This will be accomplished through directing runoff from drainage areas to onsite bio-filtration planters and bio-swales currently proposed as part of the site hydrology study.

The proposed bio-filtration systems are designed to capture site runoff from roof drains, treat the runoff through biological reactions within the planter soil media, and discharge at a rate intended to mimic pre-developed conditions. Refer to the specific system configurations, *Figure 3 – Site Specific Bio-Filtration Details*, for bio-filtration system configurations at their given locations. Sizing and capacity analysis of the proposed conventional bio-filtration systems will be calculated by following the design guidelines defined through the State of California Los Angeles Regional Water Quality Control Board. It is anticipated that the city of Inglewood will apply directly to the water board for approval. Once approval is granted to the city of Inglewood, only city approval is required for continuation. In addition, county approval of the proprietary Contech Bio-Scape Filterra systems will be pursued for this project. The system has been previously approved within the county for several other jurisdictions, this LID plan will seek to receive approval for Filterra systems specifically for use within the city for Inglewood.

#### IV. Hydromodification Analysis

As outlined in Section 8.2 of the Los Angeles County Department of Public Works Low Impact Development Standards Manual, projects may be exempt from implementation of hydromodification control measures where assessments of downstream channel conditions and proposed discharge hydrology indicate that adverse hydromodification effects to beneficial uses of natural drainage systems are unlikely. Since the proposed project site will discharge through a storm drain system into the concrete Dominguez Channel, the project is exempt from Hydromodification Control Measures.

#### V. Site Design BMPs

##### a. Site Design


Current water quality requirements are based on treating a specific volume of stormwater run-off from the project site (SWQDv). The design storm from which the SWQDv is calculated is defined as the greater of:

- ∞ The 0.75-inch, 24-hour rain event, or
- ∞ The 85<sup>th</sup> percentile, 24-hour rain event as determine by the Los Angeles County 85<sup>th</sup> percentile precipitation isohyetal map

The volume of stormwater run-off that must be retained at a project site is calculated using MODRAT. In this case, the SQWDv volume from the 85<sup>th</sup> percentile, 24-hour rain event will be utilized. LACDPW developed a hydrologic calculator (HydroCalc) that completes the full MODRAT calculation process and produce the SWQDv volumes and flow rates for single subareas. This report will utilize the results from HydroCalc as a means of determining the stormwater quality design volumes (SWQDv). The proposed site was divided into drainage sub-areas, based on the proposed site grading and proposed drainage patterns. Refer to the Conceptual Low Impact Development Exhibit, *Figure 2 – Conceptual Low Impact Development (LID) Exhibit*, for the definition of the drainage sub areas. The following table, Table 1 - Post-Development Conditions, summarizes the results of the study and required treating volumes SWQDv for each subarea.

**TABLE 1 - POST-DEVELOPMENT CONDITIONS AND BMP SUFFICIENCY SUMMARY**

| <i>Drainage Subarea</i> | <i>Project Condor</i> |                             |                         |                              |                      |                      |                   |
|-------------------------|-----------------------|-----------------------------|-------------------------|------------------------------|----------------------|----------------------|-------------------|
|                         | <b>Area (sf)</b>      | <b>Q<sub>pm</sub> (cfs)</b> | <b>SWQDv x 1.5 (cf)</b> | <b>Bio-Filtration System</b> | <b>Required (sf)</b> | <b>Provided (sf)</b> | <b>Sufficient</b> |
| DA-1                    | 90,537                | 0.5852                      | 9,671                   | Planter - Type B             | 3,868                | 4,605                | Yes               |
| DA-2                    | 33,854                | 0.3040                      | 3,627                   | Planter – Type B             | 1,451                | 2,332                | Yes               |
| DA-3                    | 43,992                | 0.3936                      | 4,697                   | Planter – Type B             | 1,879                | 3,032                | Yes               |
| DA-4                    | 18,343                | 0.1558                      | 1,953                   | Filterra                     | 68                   | 72                   | Yes               |
| DA-5                    | 39,116                | 0.3192                      | 4,185                   | Filterra                     | 143                  | 144                  | Yes               |
| DA-6                    | 45,775                | 0.4325                      | 4,883                   | Filterra                     | 179                  | 182                  | Yes               |
| DA-7                    | 41,333                | 0.2382                      | 4,418                   | Filterra                     | 130                  | 144                  | Yes               |



|               |                  |               |                |                     |       |       |     |
|---------------|------------------|---------------|----------------|---------------------|-------|-------|-----|
| DA-8          | 92,868           | 0.4714        | 9,903          | Filtterra           | 275   | 288   | Yes |
| DA-9          | 25,185           | 0.1398        | 2,697          | Filtterra           | 78    | 91    | Yes |
| DA-10         | 39,073           | 0.2951        | 4,185          | Filtterra           | 138   | 144   | Yes |
| DA-11         | 12,631           | 0.0889        | 1,349          | Filtterra           | 43    | 48    | Yes |
| RDA-1         | 17,696           | 0.1676        | 2,000          | Planter –<br>Type A | 800   | 807   | Yes |
| RDA-2         | 17,985           | 0.1595        | 2,000          | Planter –<br>Type A | 800   | 807   | Yes |
| RDA-3         | 6,815            | 0.0691        | 780            | Planter –<br>Type B | 312   | 360   | Yes |
| RDA-4A        | 154,674          | 0.9969        | 17,310         | Planter –<br>Type A | 6,924 | 6,987 | Yes |
| RDA-4B        | 154,692          | 1.0475        | 17,310         | Planter –<br>Type A | 6,924 | 7,715 | Yes |
| RDA-5         | 67,342           | 0.4834        | 7,559          | Planter –<br>Type A | 3,023 | 3,026 | Yes |
| RDA-6A        | 79,803           | 0.5883        | 8,924          | Planter –<br>Type A | 3,569 | 3,569 | Yes |
| RDA-6B        | 39,726           | 0.3384        | 4,437          | Planter –<br>Type A | 1,775 | 1,964 | Yes |
| RDA-6C        | 80,006           | 0.5915        | 8,972          | Planter –<br>Type A | 3,589 | 3,589 | Yes |
| <b>Totals</b> | <b>1,101,446</b> | <b>7.8659</b> | <b>120,855</b> |                     |       |       |     |

\*Proposed proprietary Filtterra bio-filtration system. See Appendix C for alternative design criteria calculations.


Refer to *Appendix B – Site Design Calculations for each subarea HydroCalc worksheets.*

Refer to *Appendix C – Sizing Calculations for each Bio-Filtration System calculation.*

## b. BMP Selection

All roof drainage areas, as listed in the table above, discharge via roof drains to bio-filtration planters located on the surface. The remaining roof and drainage areas will be directed to a proprietary biofiltration system designed by Contech. Refer to the conceptual low Impact Development (LID) Exhibit, *Figure 2 – Conceptual Low Impact Development (LID) Exhibit*, for stormwater routing.

Refer to the calculation sheets in *Appendix C – Bio-Filtration Sizing Calculations*, for detailed calculations demonstrating the capacity of each proposed bio-filtration system.



## **VI. Summary and Conclusion**


To summarize, the proposed low impact development (LID) system stormwater quality control measures and structural source measures are adequately designed and sized to accomplish the following:

- ∞ Capture and mitigate the SQWDv volume from the 85<sup>th</sup> percentile, 24-hour storm;
- ∞ Bio-filtration of captured volume by bio-filtration through a combination of standard bio-filtration planters and proprietary bio-filtration systems.
- ∞ Prevent pollutants from contacting stormwater run-off and/or prevent discharge of contaminated stormwater run-off to stormdrain system

Based on the calculations and conclusions presented in this report, the proposed LID stormwater quality control measures will retain on-site through bio-filtration and will mitigate the required SWQDv volumes as defined by the Los Angeles County Department of Public Works Low Impact Development Standards Manual.

## **VII. References**

County of Los Angeles Department of Public Works. (2014). *Low Impact Development Standards Manual*. Los Angeles.



## **FIGURES**





***Figure 1 — Vicinity Map***

***Figure 2 — Conceptual Low Impact Development (LID)***


***Figure 3 — Site Specific Bio-Filtration Details***












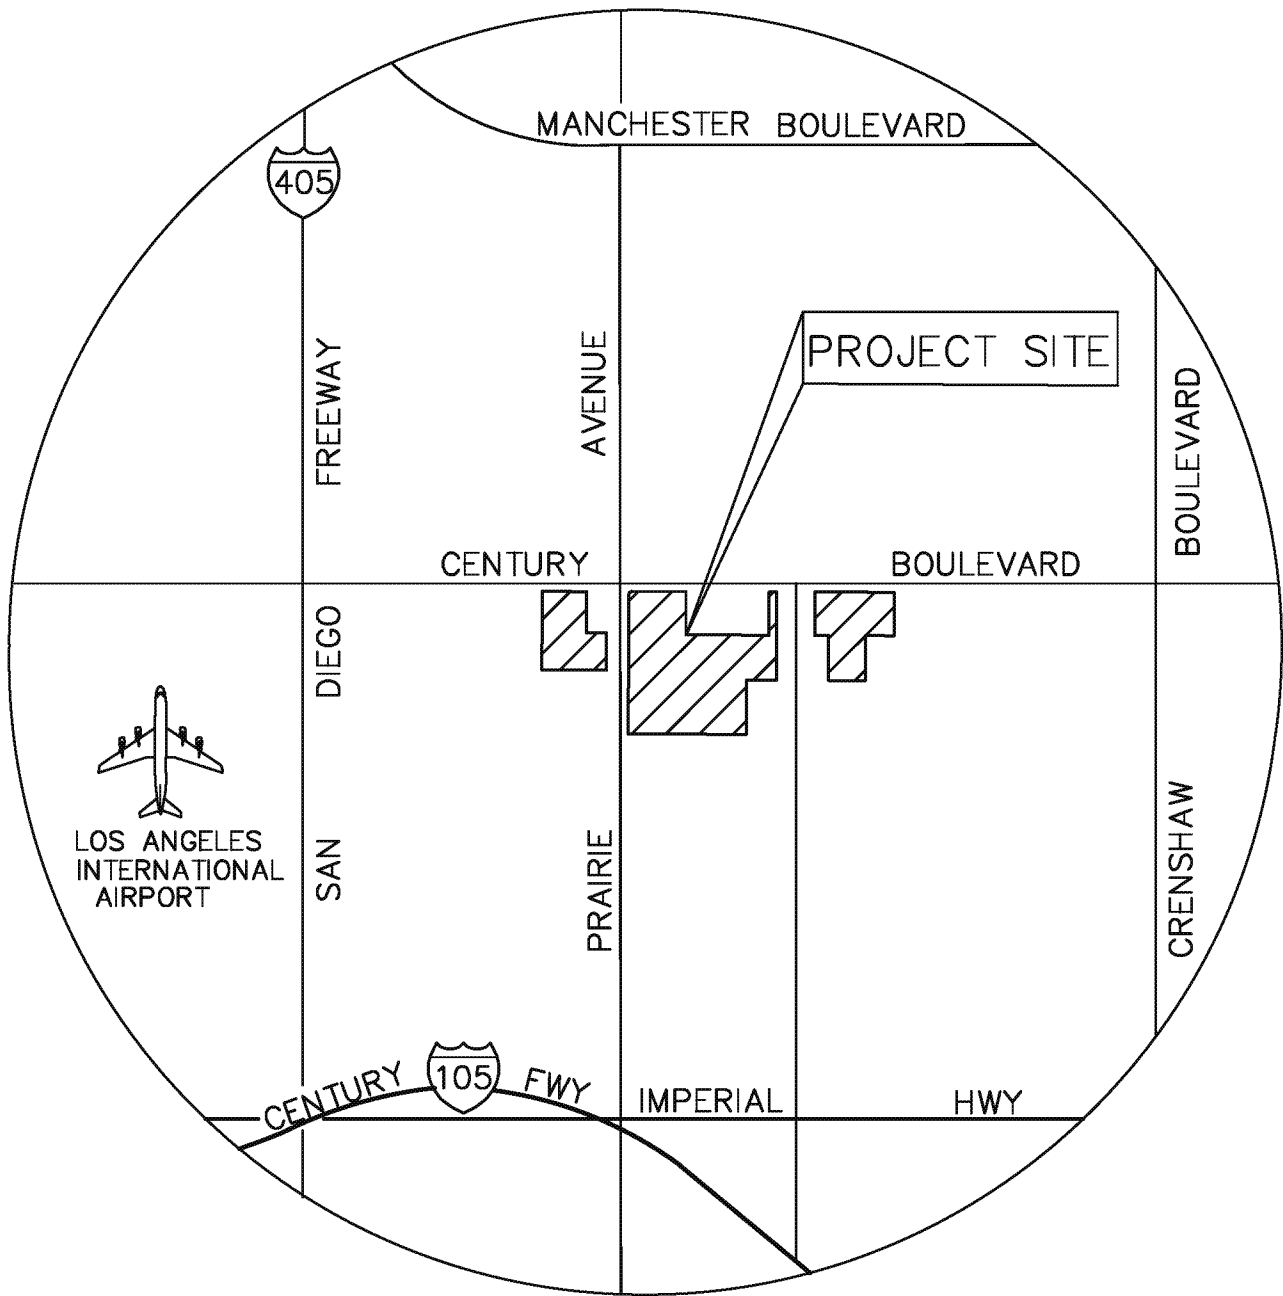


**FIGURE 1**

|  |                |  |                      |
|--|----------------|--|----------------------|
|  <p><b>D &amp; D ENGINEERING, INC.</b><br/>8901 S. LA CIENEGA BLVD, SUITE 106<br/>INGLEWOOD, CA 90301<br/>Phone: 424-393-4122</p> | PROJECT CONDOR |  | SCALE:<br>AS SHOWN   |
|  | VICINITY MAP   |  | DATE:<br>07/31/2018  |
|  |                |  | SHT NO.:<br>01 OF 01 |



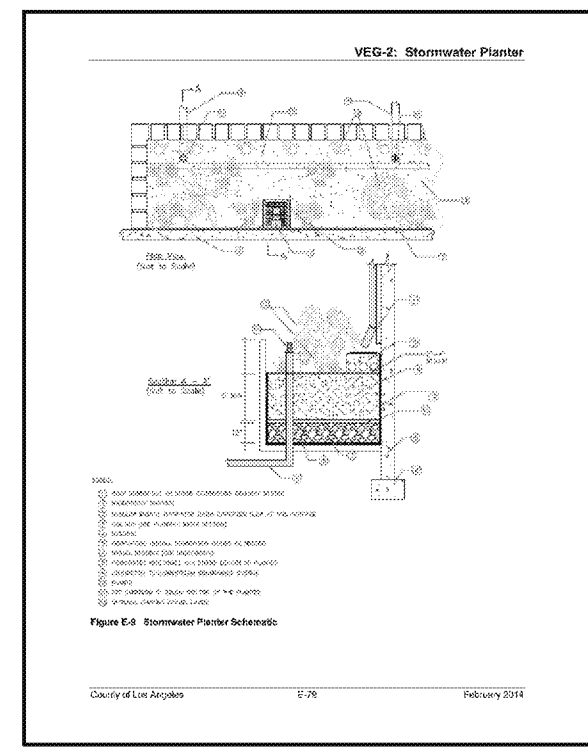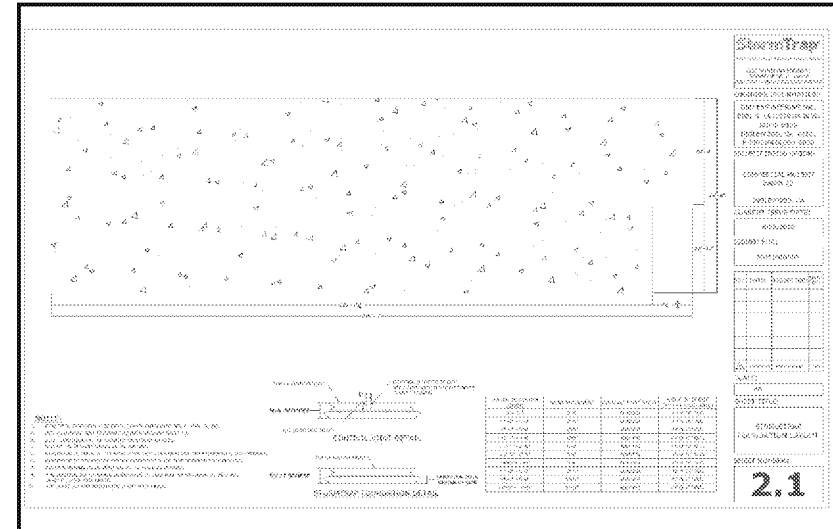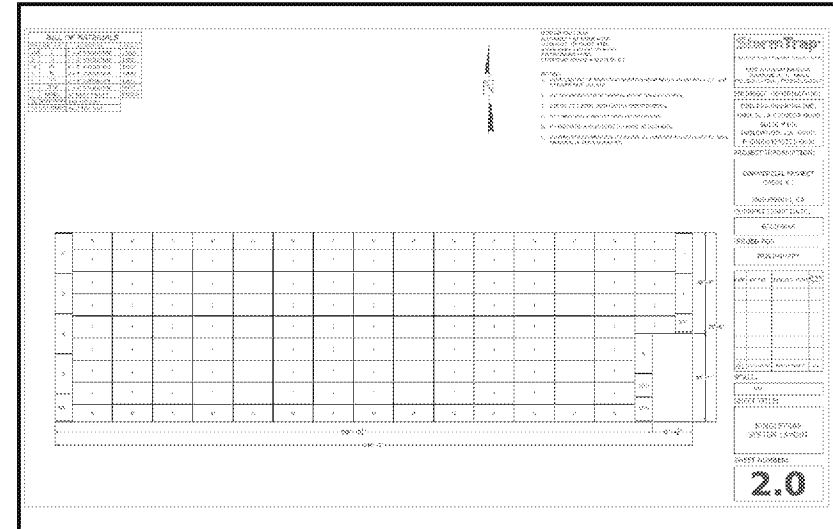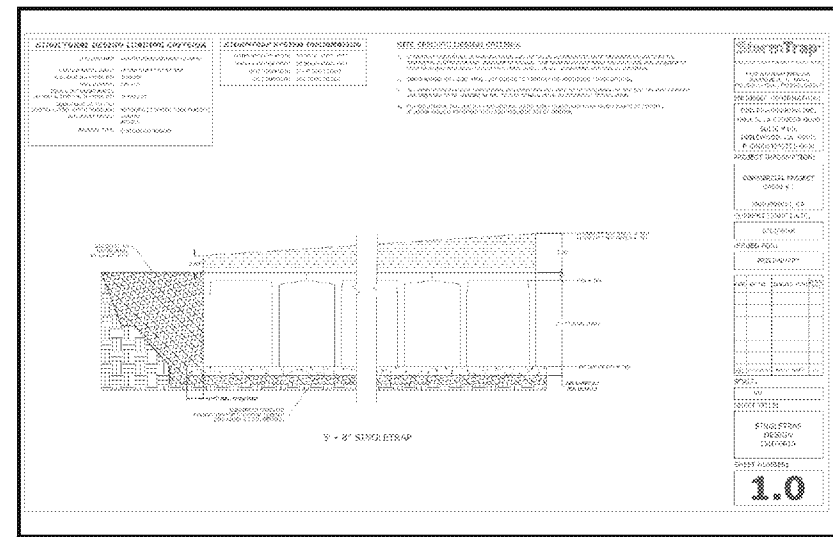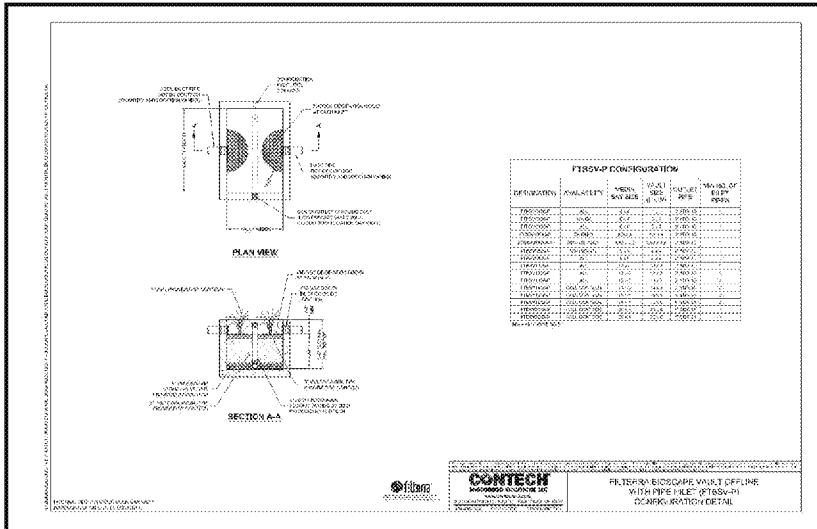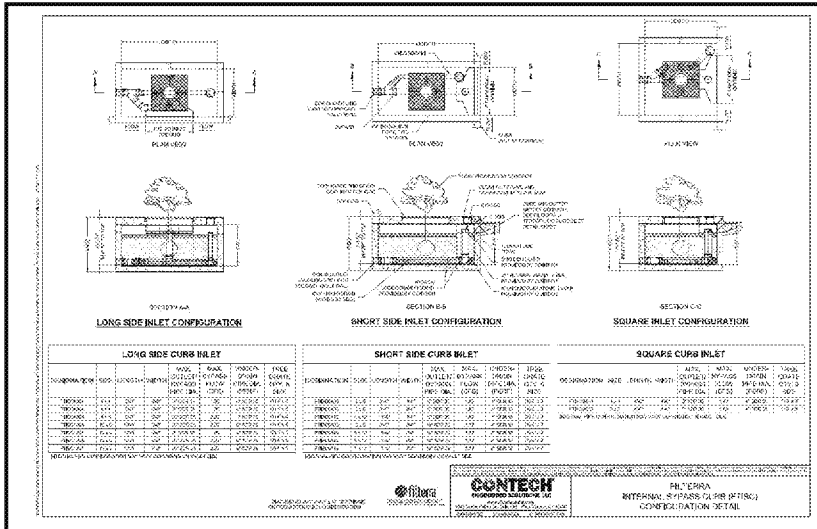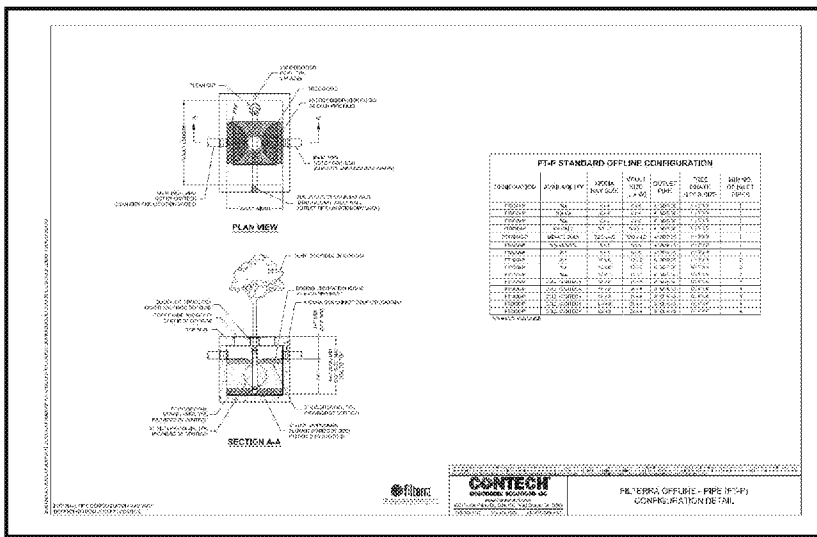

3 | BIO-FILTRATION PLANTER - TYPE A

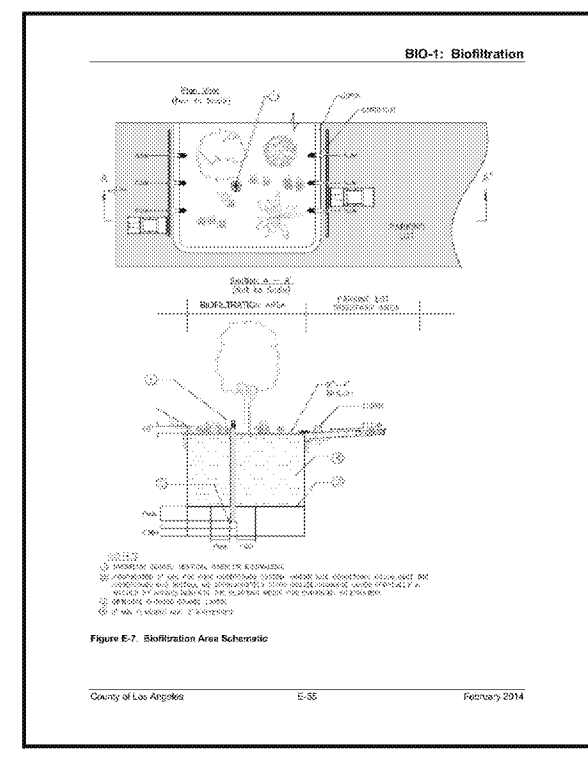

1 | FILTERRA BIO-FILTRATION DETAILS

2 | STORMTRAP SINGLETRAP DETAIL

4 | BIO-FILTRATION PLANTER - TYPE B

FIGURE 3


**D & D ENGINEERING, INC.**  
 8901 S. LA CIENEGA BLVD, SUITE 106  
 INGLEWOOD, CA 90301  
 Phone: 424-393-4122

**CONDOR**

**SITE SPECIFIC  
 BIO-FILTRATION DETAILS**

|          |            |
|----------|------------|
| SCALE:   | AS SHOWN   |
| DATE:    | 07/31/2018 |
| SHT NO.: | 01 OF 01   |

Drawing Name: M:\17001\Admin\17001-100\Reports\LID\Figures\Figure 2 - Site Specific Bio-Filtration Details.dwg  
 Last Opened: Aug 01, 2018 - 1:06pm by: Erika



## **Appendix A**



### ***Excerpt from Geotechnical Report***



### 5.11.1 Flexible Pavement Thicknesses

The following flexible pavement thicknesses for Traffic Index (TI) values of 5, 6 and 7 may be used:

Table 8 – Minimum Flexible (AC) Pavement Thicknesses

| Traffic Index (TI) | Pavement Section (feet) |                |
|--------------------|-------------------------|----------------|
|                    | Asphaltic Concrete      | Aggregate Base |
| 4 to 5             | 0.3                     | 0.55           |
| 6 to 7             | 0.4                     | 0.65           |
| 7 to 8             | 0.5                     | 0.75           |

### 5.11.2 Concrete Flatwork / Hardscape and Sidewalks

For PCC pavements in pedestrian areas, a pavement section of 4 inches PCC over 6 inches of aggregate base is typical for the kinds of soils to be expected at the site.


It should be noted that the above recommendations apply to parking lot, driveway and street areas only. Loading docks and trash enclosures should be paved with PCC pavement. We recommend that the section consist of a minimum of 6 inches of reinforced Portland cement concrete over 4 inches of Caltrans Class 2 Base with a minimum R-value of 78. The aggregate base should be compacted to at least 95 percent of the maximum dry density per ASTM D-1557 over unyielding subgrade.

## 5.12 INFILTRATION FEASIBILITY

Preliminary percolation tests were conducted at five (5) selected locations at the site (P-1 through P-5). The results of percolation testing are summarized in Appendix D.

Based on the results, infiltration rates for the soils in the upper 10 feet ranged from 0.32 to 3.52 in/hr. The test results represent a sampling of the upper materials which consist of variable and predominately clayey and silty sands. The upper value may be due to localized presence of more granular soils at the particular test location (P-2).

However, as discussed in this report, the subsurface native soils at the site consist predominately of clayey soils with estimated infiltration rates lower than 0.3 in/hr and with few or no connectivity to permeable soil horizons of adequate thickness. Moreover, the underlying, predominately clayey soils have never experienced saturation and have been found to exhibit more compressibility when inundated; therefore any infiltration of water into the subsurface soils, particularly within the areas to be occupied by permanent structures, is highly discouraged from a foundation performance stand-point. Given these constraints, infiltration practices might not be feasible at the site.



## **Appendix B**



### ***Post-Development Hydrological Conditions***



## Peak Flow Hydrologic Analysis


File location: M:/17001/Eng/17001/Hm/LID/Project Condor Report.pdf  
Version: HydroCalc 1.0.3

### Input Parameters

|                                     |                       |
|-------------------------------------|-----------------------|
| Project Name                        | Project Condor        |
| Subarea ID                          | DA-1                  |
| Area (ac)                           | 2.08                  |
| Flow Path Length (ft)               | 315.0                 |
| Flow Path Slope (vft/hft)           | 0.01                  |
| 85th Percentile Rainfall Depth (in) | 1.05                  |
| Percent Impervious                  | 0.9                   |
| Soil Type                           | 13                    |
| Design Storm Frequency              | 85th percentile storm |
| Fire Factor                         | 0                     |
| LID                                 | True                  |

### Output Results

|   |           |
|---|-----------|
| Modeled (85th percentile storm) Rainfall Depth (in) | 1.05      |
| Peak Intensity (in/hr)                              | 0.3431    |
| Undeveloped Runoff Coefficient (Cu)                 | 0.1       |
| Developed Runoff Coefficient (Cd)                   | 0.82      |
| Time of Concentration (min)                         | 18.0      |
| Clear Peak Flow Rate (cfs)                          | 0.5852    |
| Burned Peak Flow Rate (cfs)                         | 0.5852    |
| 24-Hr Clear Runoff Volume (ac-ft)                   | 0.148     |
| 24-Hr Clear Runoff Volume (cu-ft)                   | 6447.1944 |

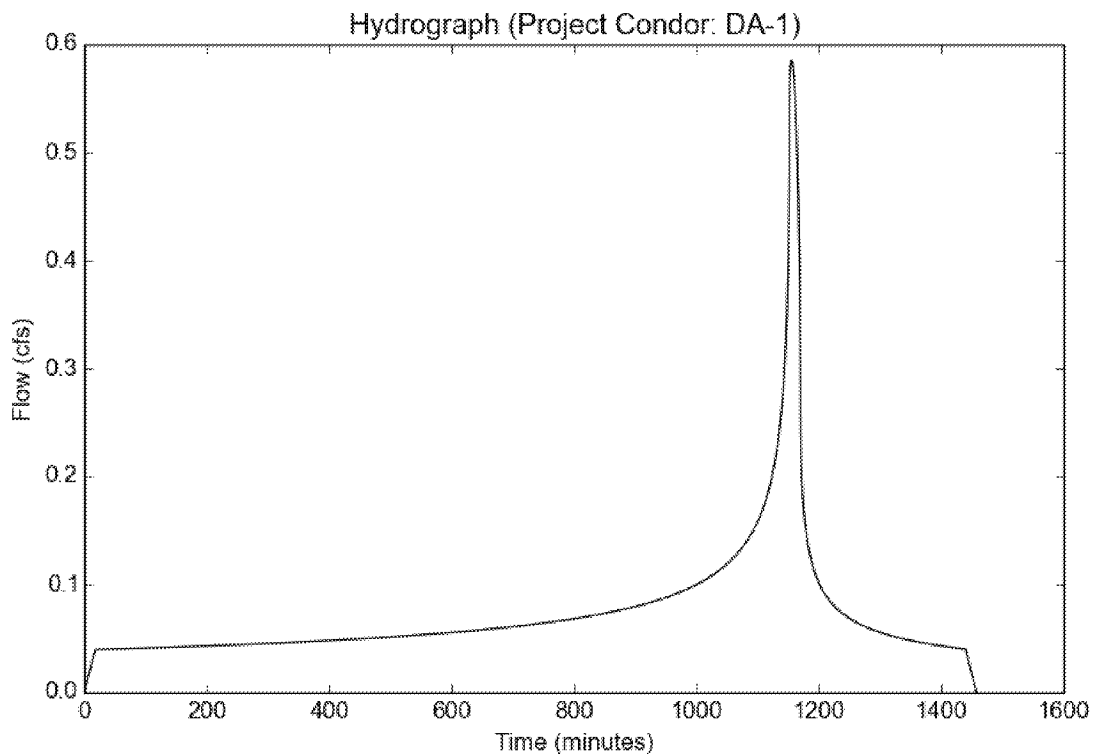

## Peak Flow Hydrologic Analysis


File location: M:/17001/Eng/17001/Hm/LID/Project Condor Report.pdf  
Version: HydroCalc 1.0.3

### Input Parameters

|                                     |                       |
|-------------------------------------|-----------------------|
| Project Name                        | Project Condor        |
| Subarea ID                          | DA-2                  |
| Area (ac)                           | 0.78                  |
| Flow Path Length (ft)               | 100.0                 |
| Flow Path Slope (vft/hft)           | 0.01                  |
| 85th Percentile Rainfall Depth (in) | 1.05                  |
| Percent Impervious                  | 0.9                   |
| Soil Type                           | 13                    |
| Design Storm Frequency              | 85th percentile storm |
| Fire Factor                         | 0                     |
| LID                                 | True                  |

### Output Results

|   |           |
|---|-----------|
| Modeled (85th percentile storm) Rainfall Depth (in) | 1.05      |
| Peak Intensity (in/hr)                              | 0.4752    |
| Undeveloped Runoff Coefficient (Cu)                 | 0.1       |
| Developed Runoff Coefficient (Cd)                   | 0.82      |
| Time of Concentration (min)                         | 9.0       |
| Clear Peak Flow Rate (cfs)                          | 0.304     |
| Burned Peak Flow Rate (cfs)                         | 0.304     |
| 24-Hr Clear Runoff Volume (ac-ft)                   | 0.0555    |
| 24-Hr Clear Runoff Volume (cu-ft)                   | 2417.6905 |

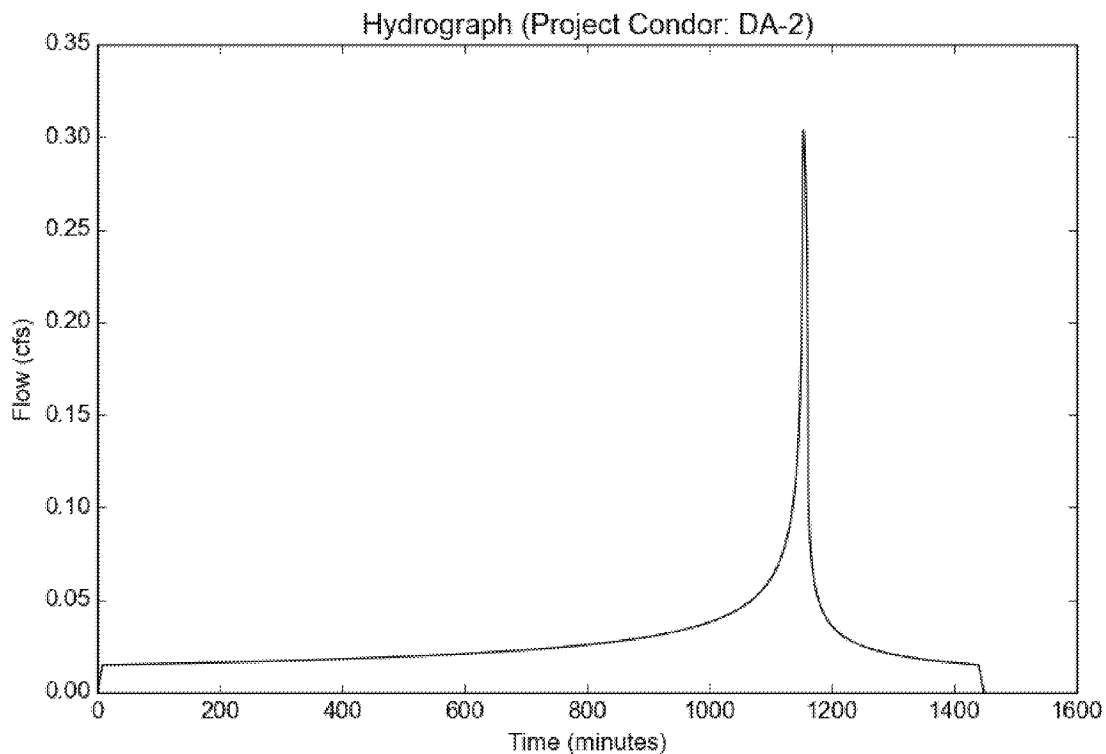



## Peak Flow Hydrologic Analysis


File location: M:/17001/Eng/17001/Hm/LID/Project Condor Report.pdf  
Version: HydroCalc 1.0.3

### Input Parameters

|                                     |                       |
|-------------------------------------|-----------------------|
| Project Name                        | Project Condor        |
| Subarea ID                          | DA-3                  |
| Area (ac)                           | 1.01                  |
| Flow Path Length (ft)               | 110.0                 |
| Flow Path Slope (vft/hft)           | 0.01                  |
| 85th Percentile Rainfall Depth (in) | 1.05                  |
| Percent Impervious                  | 0.9                   |
| Soil Type                           | 13                    |
| Design Storm Frequency              | 85th percentile storm |
| Fire Factor                         | 0                     |
| LID                                 | True                  |

### Output Results

|   |           |
|---|-----------|
| Modeled (85th percentile storm) Rainfall Depth (in) | 1.05      |
| Peak Intensity (in/hr)                              | 0.4752    |
| Undeveloped Runoff Coefficient (Cu)                 | 0.1       |
| Developed Runoff Coefficient (Cd)                   | 0.82      |
| Time of Concentration (min)                         | 9.0       |
| Clear Peak Flow Rate (cfs)                          | 0.3936    |
| Burned Peak Flow Rate (cfs)                         | 0.3936    |
| 24-Hr Clear Runoff Volume (ac-ft)                   | 0.0719    |
| 24-Hr Clear Runoff Volume (cu-ft)                   | 3130.5992 |

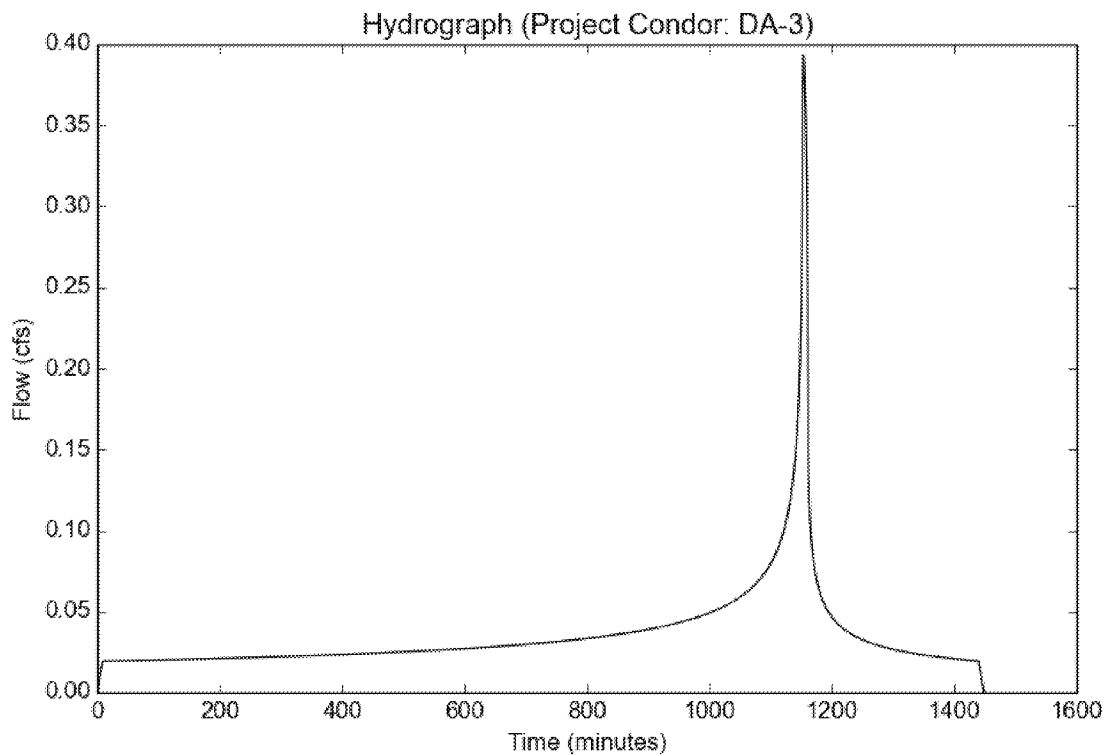

## Peak Flow Hydrologic Analysis


File location: M:/17001/Eng/17001/Hm/LID/Project Condor Report.pdf  
Version: HydroCalc 1.0.3

### Input Parameters

|                                     |                       |
|-------------------------------------|-----------------------|
| Project Name                        | Project Condor        |
| Subarea ID                          | DA-4                  |
| Area (ac)                           | 0.42                  |
| Flow Path Length (ft)               | 120.0                 |
| Flow Path Slope (vft/hft)           | 0.01                  |
| 85th Percentile Rainfall Depth (in) | 1.05                  |
| Percent Impervious                  | 0.9                   |
| Soil Type                           | 13                    |
| Design Storm Frequency              | 85th percentile storm |
| Fire Factor                         | 0                     |
| LID                                 | True                  |

### Output Results

|   |           |
|---|-----------|
| Modeled (85th percentile storm) Rainfall Depth (in) | 1.05      |
| Peak Intensity (in/hr)                              | 0.4523    |
| Undeveloped Runoff Coefficient (Cu)                 | 0.1       |
| Developed Runoff Coefficient (Cd)                   | 0.82      |
| Time of Concentration (min)                         | 10.0      |
| Clear Peak Flow Rate (cfs)                          | 0.1558    |
| Burned Peak Flow Rate (cfs)                         | 0.1558    |
| 24-Hr Clear Runoff Volume (ac-ft)                   | 0.0299    |
| 24-Hr Clear Runoff Volume (cu-ft)                   | 1301.8336 |

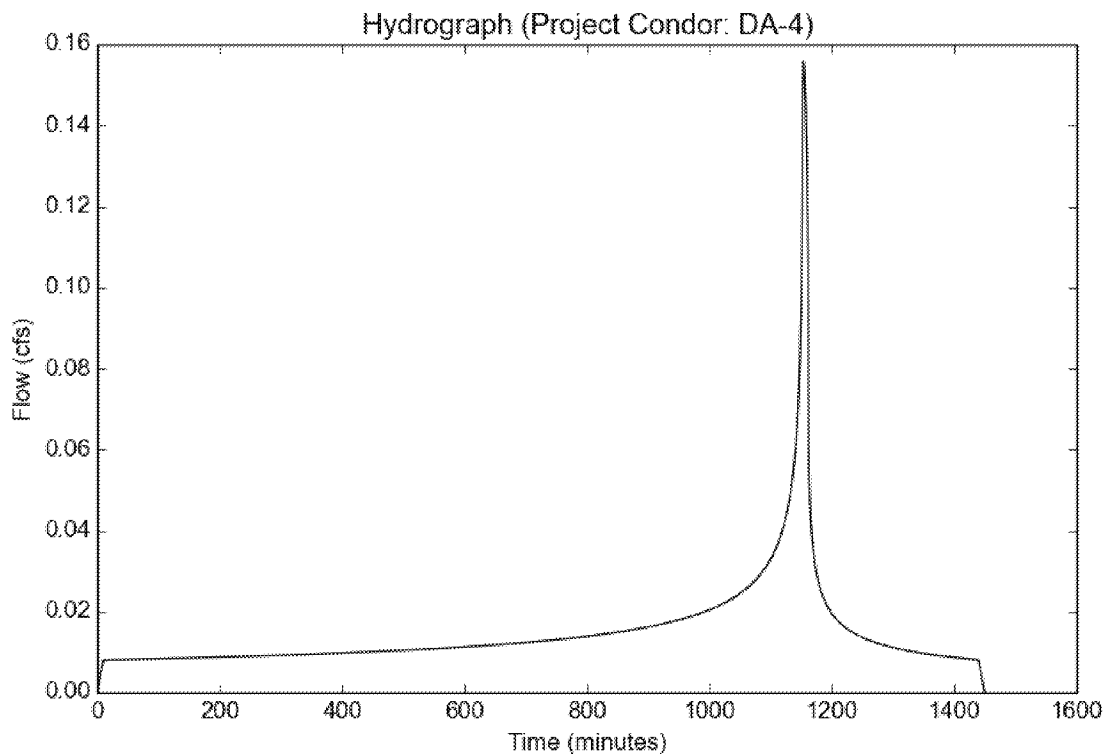

## Peak Flow Hydrologic Analysis


File location: M:/17001/Eng/17001/Hm/LID/Project Condor Report.pdf  
Version: HydroCalc 1.0.3

### Input Parameters

|                                     |                       |
|-------------------------------------|-----------------------|
| Project Name                        | Project Condor        |
| Subarea ID                          | DA-5                  |
| Area (ac)                           | 0.9                   |
| Flow Path Length (ft)               | 140.0                 |
| Flow Path Slope (vft/hft)           | 0.01                  |
| 85th Percentile Rainfall Depth (in) | 1.05                  |
| Percent Impervious                  | 0.9                   |
| Soil Type                           | 13                    |
| Design Storm Frequency              | 85th percentile storm |
| Fire Factor                         | 0                     |
| LID                                 | True                  |

### Output Results

|   |           |
|---|-----------|
| Modeled (85th percentile storm) Rainfall Depth (in) | 1.05      |
| Peak Intensity (in/hr)                              | 0.4325    |
| Undeveloped Runoff Coefficient (Cu)                 | 0.1       |
| Developed Runoff Coefficient (Cd)                   | 0.82      |
| Time of Concentration (min)                         | 11.0      |
| Clear Peak Flow Rate (cfs)                          | 0.3192    |
| Burned Peak Flow Rate (cfs)                         | 0.3192    |
| 24-Hr Clear Runoff Volume (ac-ft)                   | 0.064     |
| 24-Hr Clear Runoff Volume (cu-ft)                   | 2789.6443 |

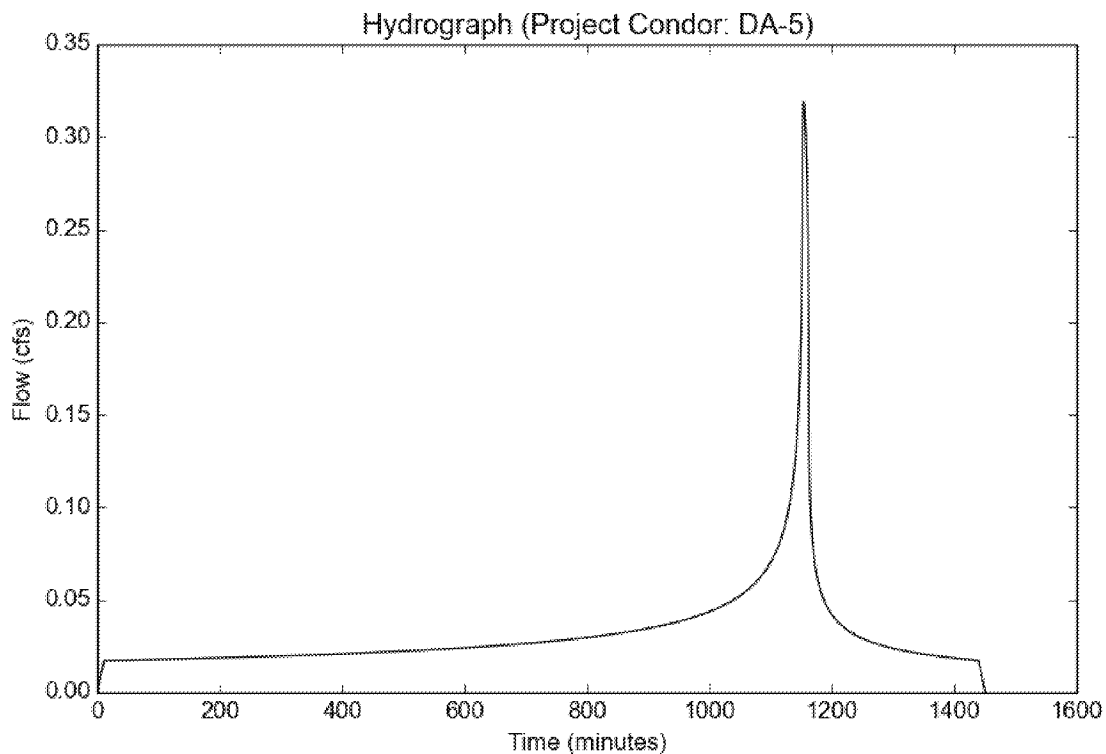

# Peak Flow Hydrologic Analysis


File location: M:/17001/Eng/17001/Hm/LID/Project Condor Report.pdf  
Version: HydroCalc 1.0.3

## Input Parameters

|                                     |                       |
|-------------------------------------|-----------------------|
| Project Name                        | Project Condor        |
| Subarea ID                          | DA-6                  |
| Area (ac)                           | 1.05                  |
| Flow Path Length (ft)               | 90.0                  |
| Flow Path Slope (vft/hft)           | 0.01                  |
| 85th Percentile Rainfall Depth (in) | 1.05                  |
| Percent Impervious                  | 0.9                   |
| Soil Type                           | 13                    |
| Design Storm Frequency              | 85th percentile storm |
| Fire Factor                         | 0                     |
| LID                                 | True                  |

## Output Results

|   |           |
|---|-----------|
| Modeled (85th percentile storm) Rainfall Depth (in) | 1.05      |
| Peak Intensity (in/hr)                              | 0.5023    |
| Undeveloped Runoff Coefficient (Cu)                 | 0.1       |
| Developed Runoff Coefficient (Cd)                   | 0.82      |
| Time of Concentration (min)                         | 8.0       |
| Clear Peak Flow Rate (cfs)                          | 0.4325    |
| Burned Peak Flow Rate (cfs)                         | 0.4325    |
| 24-Hr Clear Runoff Volume (ac-ft)                   | 0.0747    |
| 24-Hr Clear Runoff Volume (cu-ft)                   | 3254.5826 |

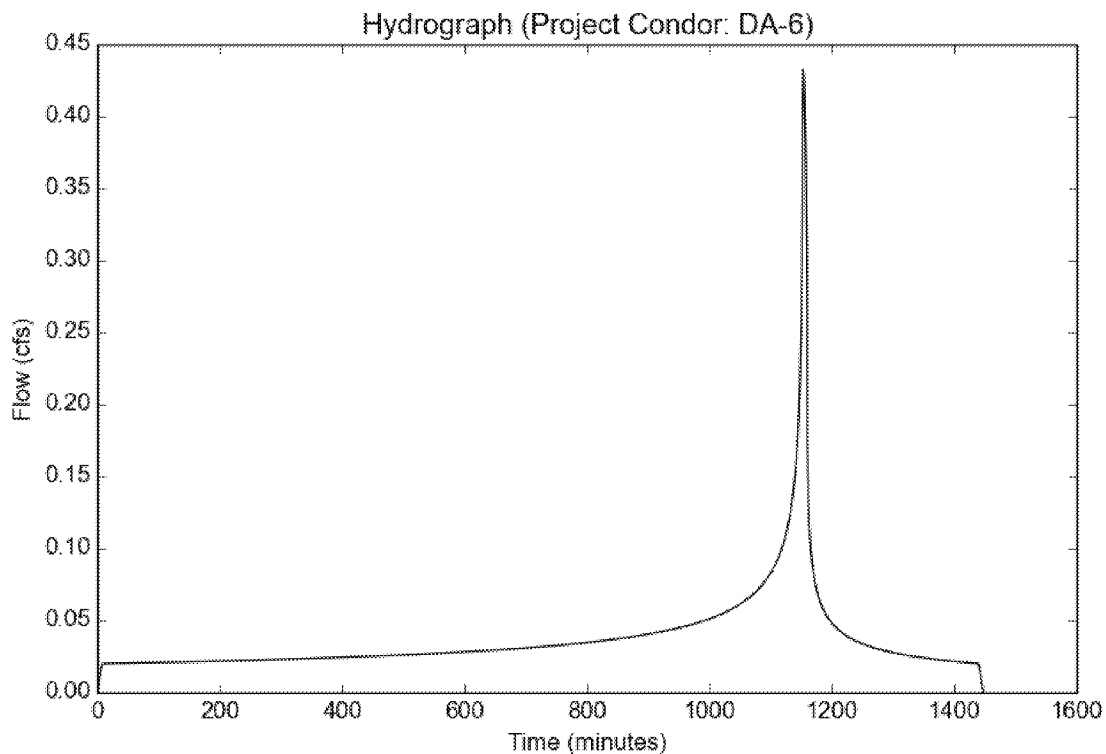

## Peak Flow Hydrologic Analysis


File location: M:/17001/Eng/17001/Hm/LID/Project Condor Report.pdf  
Version: HydroCalc 1.0.3

### Input Parameters

|                                     |                       |
|-------------------------------------|-----------------------|
| Project Name                        | Project Condor        |
| Subarea ID                          | DA-7                  |
| Area (ac)                           | 0.95                  |
| Flow Path Length (ft)               | 450.0                 |
| Flow Path Slope (vft/hft)           | 0.01                  |
| 85th Percentile Rainfall Depth (in) | 1.05                  |
| Percent Impervious                  | 0.9                   |
| Soil Type                           | 13                    |
| Design Storm Frequency              | 85th percentile storm |
| Fire Factor                         | 0                     |
| LID                                 | True                  |

### Output Results

|   |           |
|---|-----------|
| Modeled (85th percentile storm) Rainfall Depth (in) | 1.05      |
| Peak Intensity (in/hr)                              | 0.3058    |
| Undeveloped Runoff Coefficient (Cu)                 | 0.1       |
| Developed Runoff Coefficient (Cd)                   | 0.82      |
| Time of Concentration (min)                         | 23.0      |
| Clear Peak Flow Rate (cfs)                          | 0.2382    |
| Burned Peak Flow Rate (cfs)                         | 0.2382    |
| 24-Hr Clear Runoff Volume (ac-ft)                   | 0.0676    |
| 24-Hr Clear Runoff Volume (cu-ft)                   | 2944.6398 |

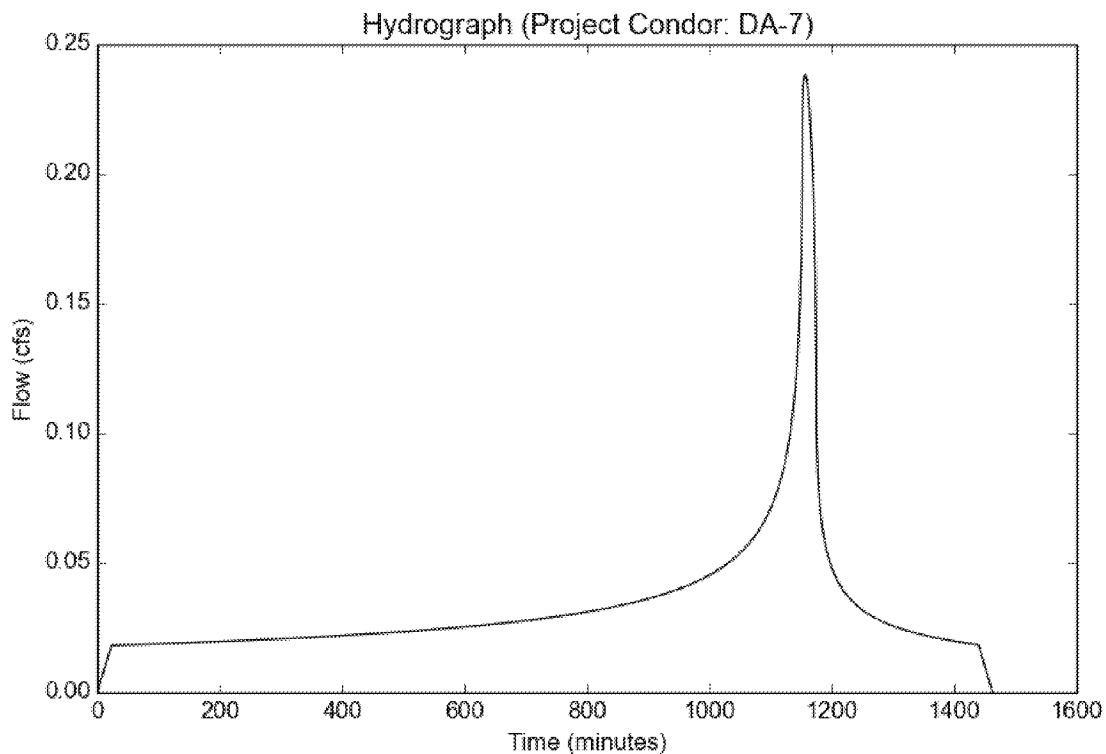

## Peak Flow Hydrologic Analysis


File location: M:/17001/Eng/17001/Hm/LID/Project Condor Report.pdf  
Version: HydroCalc 1.0.3

### Input Parameters

|                                     |                       |
|-------------------------------------|-----------------------|
| Project Name                        | Project Condor        |
| Subarea ID                          | DA-8                  |
| Area (ac)                           | 2.13                  |
| Flow Path Length (ft)               | 700.0                 |
| Flow Path Slope (vft/hft)           | 0.01                  |
| 85th Percentile Rainfall Depth (in) | 1.05                  |
| Percent Impervious                  | 0.9                   |
| Soil Type                           | 13                    |
| Design Storm Frequency              | 85th percentile storm |
| Fire Factor                         | 0                     |
| LID                                 | True                  |

### Output Results

|   |           |
|---|-----------|
| Modeled (85th percentile storm) Rainfall Depth (in) | 1.05      |
| Peak Intensity (in/hr)                              | 0.2699    |
| Undeveloped Runoff Coefficient (Cu)                 | 0.1       |
| Developed Runoff Coefficient (Cd)                   | 0.82      |
| Time of Concentration (min)                         | 30.0      |
| Clear Peak Flow Rate (cfs)                          | 0.4714    |
| Burned Peak Flow Rate (cfs)                         | 0.4714    |
| 24-Hr Clear Runoff Volume (ac-ft)                   | 0.1516    |
| 24-Hr Clear Runoff Volume (cu-ft)                   | 6602.2238 |

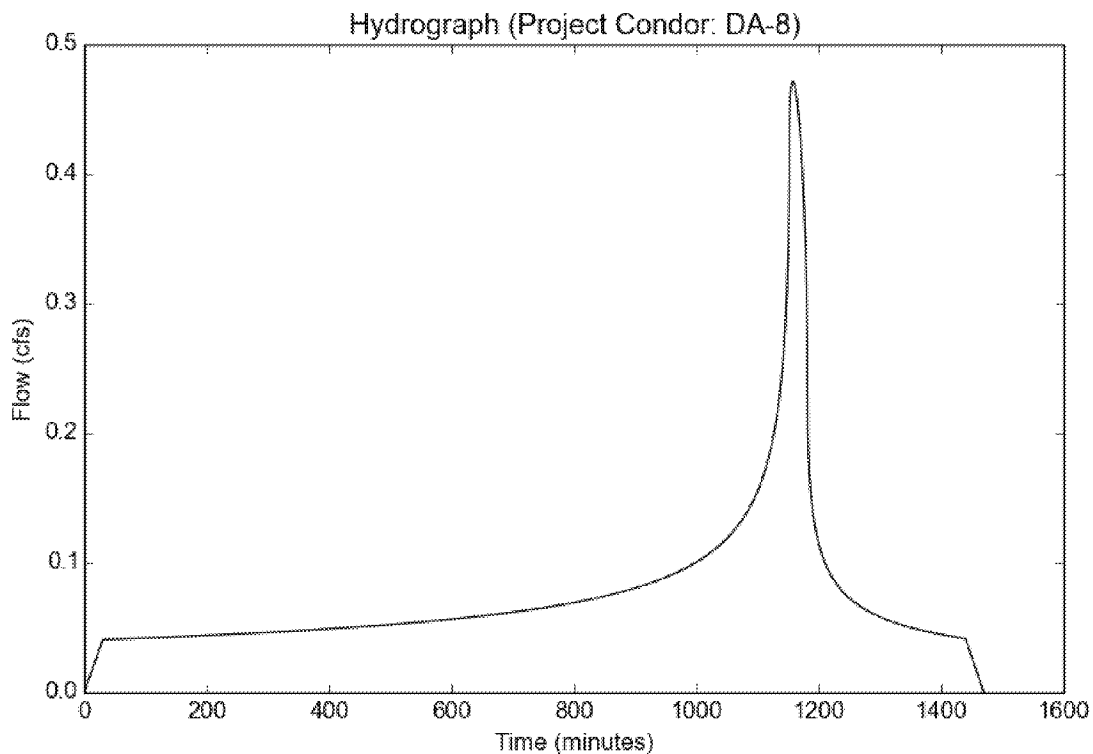

## Peak Flow Hydrologic Analysis


File location: M:/17001/Eng/17001/Hm/LID/Project Condor Report.pdf  
Version: HydroCalc 1.0.3

### Input Parameters

|                                     |                       |
|-------------------------------------|-----------------------|
| Project Name                        | Project Condor        |
| Subarea ID                          | DA-9                  |
| Area (ac)                           | 0.58                  |
| Flow Path Length (ft)               | 530.0                 |
| Flow Path Slope (vft/hft)           | 0.01                  |
| 85th Percentile Rainfall Depth (in) | 1.05                  |
| Percent Impervious                  | 0.9                   |
| Soil Type                           | 13                    |
| Design Storm Frequency              | 85th percentile storm |
| Fire Factor                         | 0                     |
| LID                                 | True                  |

### Output Results

|   |           |
|---|-----------|
| Modeled (85th percentile storm) Rainfall Depth (in) | 1.05      |
| Peak Intensity (in/hr)                              | 0.294     |
| Undeveloped Runoff Coefficient (Cu)                 | 0.1       |
| Developed Runoff Coefficient (Cd)                   | 0.82      |
| Time of Concentration (min)                         | 25.0      |
| Clear Peak Flow Rate (cfs)                          | 0.1398    |
| Burned Peak Flow Rate (cfs)                         | 0.1398    |
| 24-Hr Clear Runoff Volume (ac-ft)                   | 0.0413    |
| 24-Hr Clear Runoff Volume (cu-ft)                   | 1797.7823 |

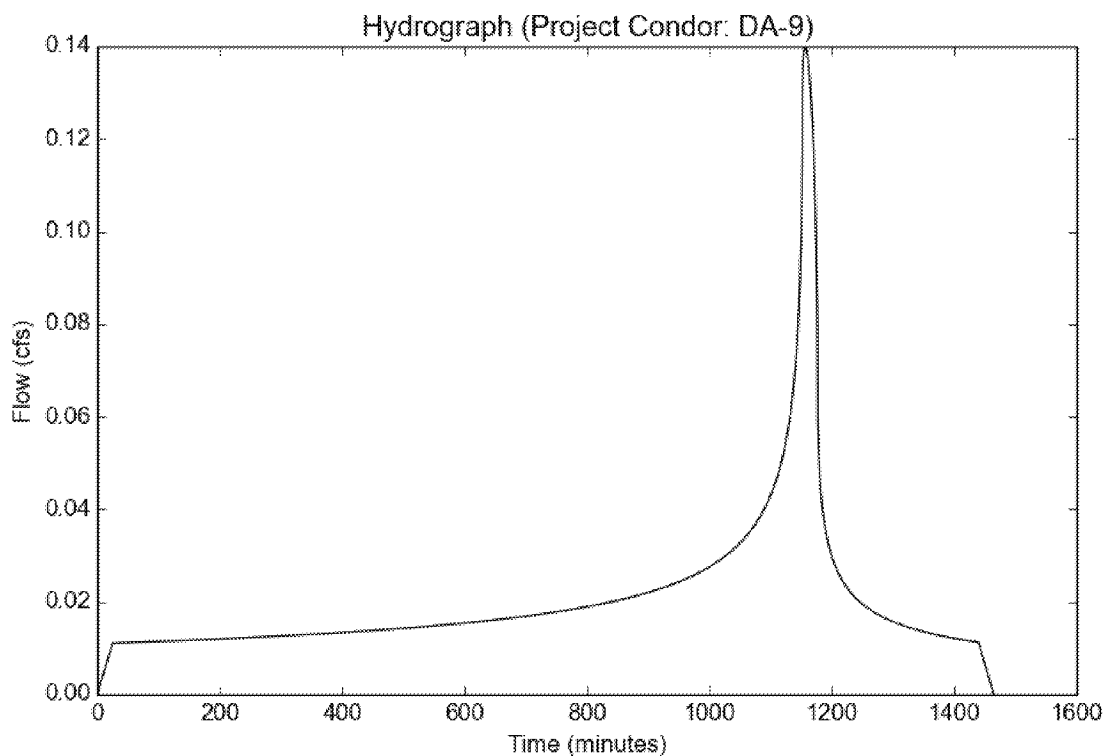

## Peak Flow Hydrologic Analysis


File location: M:/17001/Eng/17001/Hm/LID/Project Condor Report.pdf  
Version: HydroCalc 1.0.3

### Input Parameters

|                                     |                       |
|-------------------------------------|-----------------------|
| Project Name                        | Project Condor        |
| Subarea ID                          | DA-10                 |
| Area (ac)                           | 0.9                   |
| Flow Path Length (ft)               | 200.0                 |
| Flow Path Slope (vft/hft)           | 0.01                  |
| 85th Percentile Rainfall Depth (in) | 1.05                  |
| Percent Impervious                  | 0.9                   |
| Soil Type                           | 13                    |
| Design Storm Frequency              | 85th percentile storm |
| Fire Factor                         | 0                     |
| LID                                 | True                  |

### Output Results

|   |           |
|---|-----------|
| Modeled (85th percentile storm) Rainfall Depth (in) | 1.05      |
| Peak Intensity (in/hr)                              | 0.3998    |
| Undeveloped Runoff Coefficient (Cu)                 | 0.1       |
| Developed Runoff Coefficient (Cd)                   | 0.82      |
| Time of Concentration (min)                         | 13.0      |
| Clear Peak Flow Rate (cfs)                          | 0.2951    |
| Burned Peak Flow Rate (cfs)                         | 0.2951    |
| 24-Hr Clear Runoff Volume (ac-ft)                   | 0.064     |
| 24-Hr Clear Runoff Volume (cu-ft)                   | 2789.6459 |

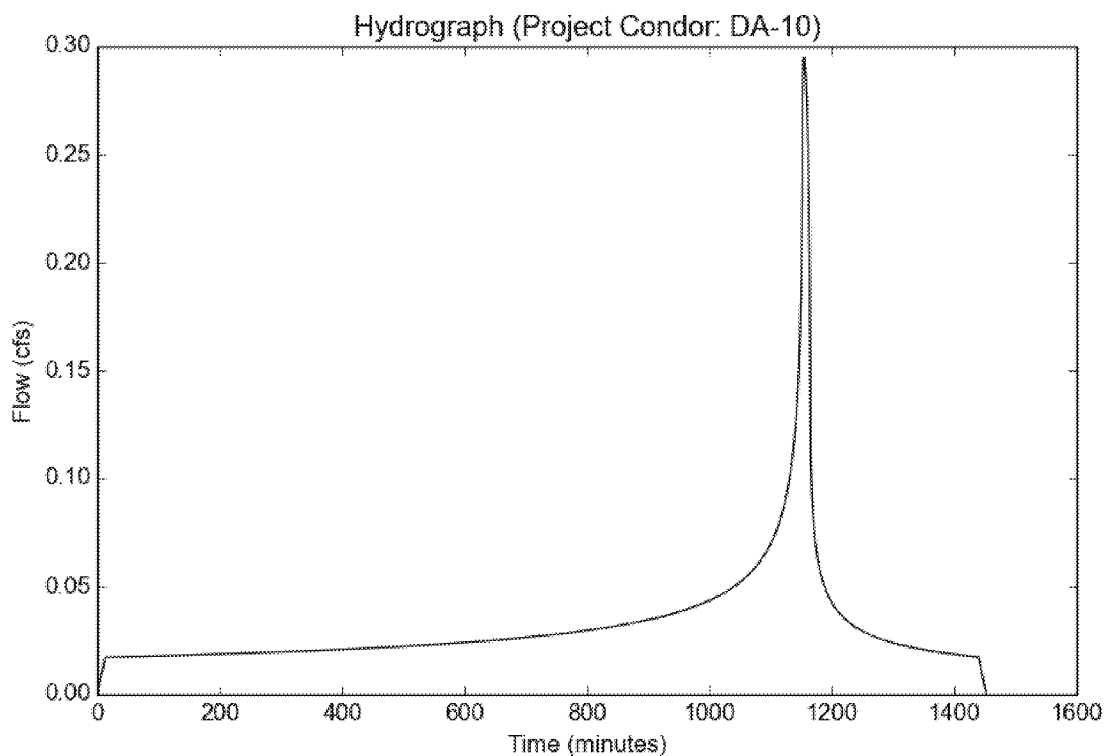



# Peak Flow Hydrologic Analysis


File location: M:/17001/Eng/17001/Hm/LID/Project Condor Report.pdf  
Version: HydroCalc 1.0.3

## Input Parameters

|                                     |                       |
|-------------------------------------|-----------------------|
| Project Name                        | Project Condor        |
| Subarea ID                          | DA-11                 |
| Area (ac)                           | 0.29                  |
| Flow Path Length (ft)               | 240.0                 |
| Flow Path Slope (vft/hft)           | 0.01                  |
| 85th Percentile Rainfall Depth (in) | 1.05                  |
| Percent Impervious                  | 0.9                   |
| Soil Type                           | 13                    |
| Design Storm Frequency              | 85th percentile storm |
| Fire Factor                         | 0                     |
| LID                                 | True                  |

## Output Results

|   |          |
|---|----------|
| Modeled (85th percentile storm) Rainfall Depth (in) | 1.05     |
| Peak Intensity (in/hr)                              | 0.3738   |
| Undeveloped Runoff Coefficient (Cu)                 | 0.1      |
| Developed Runoff Coefficient (Cd)                   | 0.82     |
| Time of Concentration (min)                         | 15.0     |
| Clear Peak Flow Rate (cfs)                          | 0.0889   |
| Burned Peak Flow Rate (cfs)                         | 0.0889   |
| 24-Hr Clear Runoff Volume (ac-ft)                   | 0.0206   |
| 24-Hr Clear Runoff Volume (cu-ft)                   | 898.8866 |

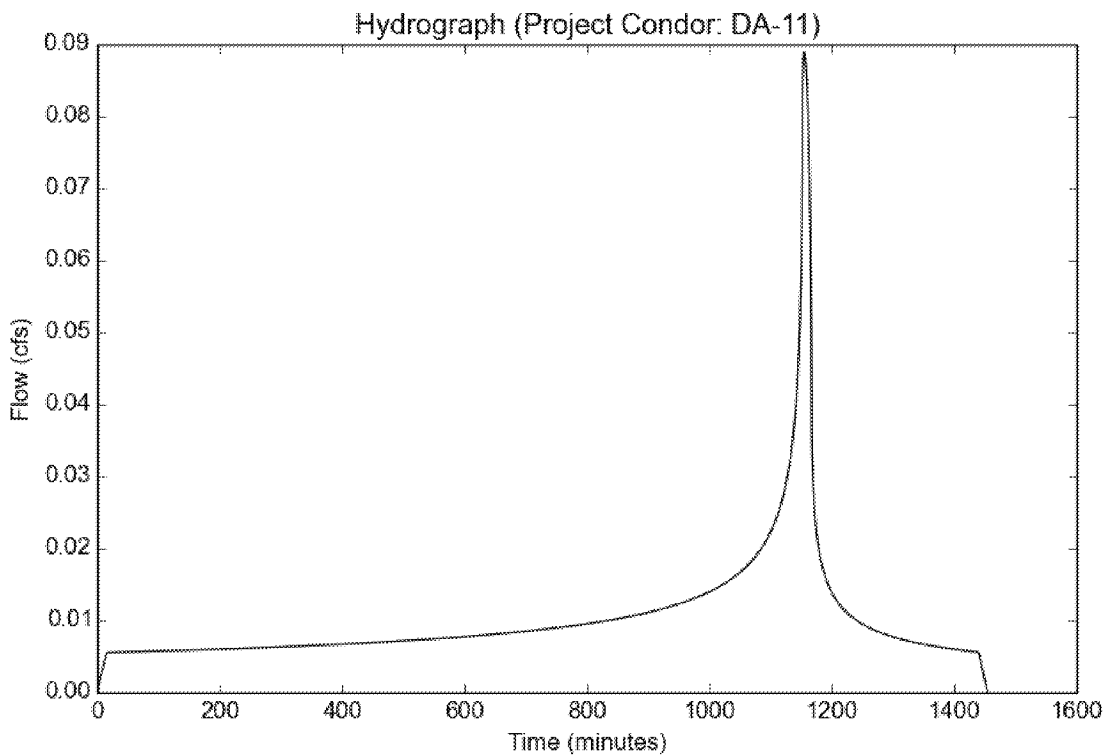

## Peak Flow Hydrologic Analysis


File location: M:/17001/Eng/17001/Hm/LID/Project Condor Report.pdf  
Version: HydroCalc 1.0.3

### Input Parameters

|                                     |                       |
|-------------------------------------|-----------------------|
| Project Name                        | Project Condor        |
| Subarea ID                          | RDA-1                 |
| Area (ac)                           | 0.41                  |
| Flow Path Length (ft)               | 130.0                 |
| Flow Path Slope (vft/hft)           | 0.02                  |
| 85th Percentile Rainfall Depth (in) | 1.05                  |
| Percent Impervious                  | 0.95                  |
| Soil Type                           | 13                    |
| Design Storm Frequency              | 85th percentile storm |
| Fire Factor                         | 0                     |
| LID                                 | True                  |

### Output Results

|   |           |
|---|-----------|
| Modeled (85th percentile storm) Rainfall Depth (in) | 1.05      |
| Peak Intensity (in/hr)                              | 0.4752    |
| Undeveloped Runoff Coefficient (Cu)                 | 0.1       |
| Developed Runoff Coefficient (Cd)                   | 0.86      |
| Time of Concentration (min)                         | 9.0       |
| Clear Peak Flow Rate (cfs)                          | 0.1676    |
| Burned Peak Flow Rate (cfs)                         | 0.1676    |
| 24-Hr Clear Runoff Volume (ac-ft)                   | 0.0306    |
| 24-Hr Clear Runoff Volume (cu-ft)                   | 1332.8294 |

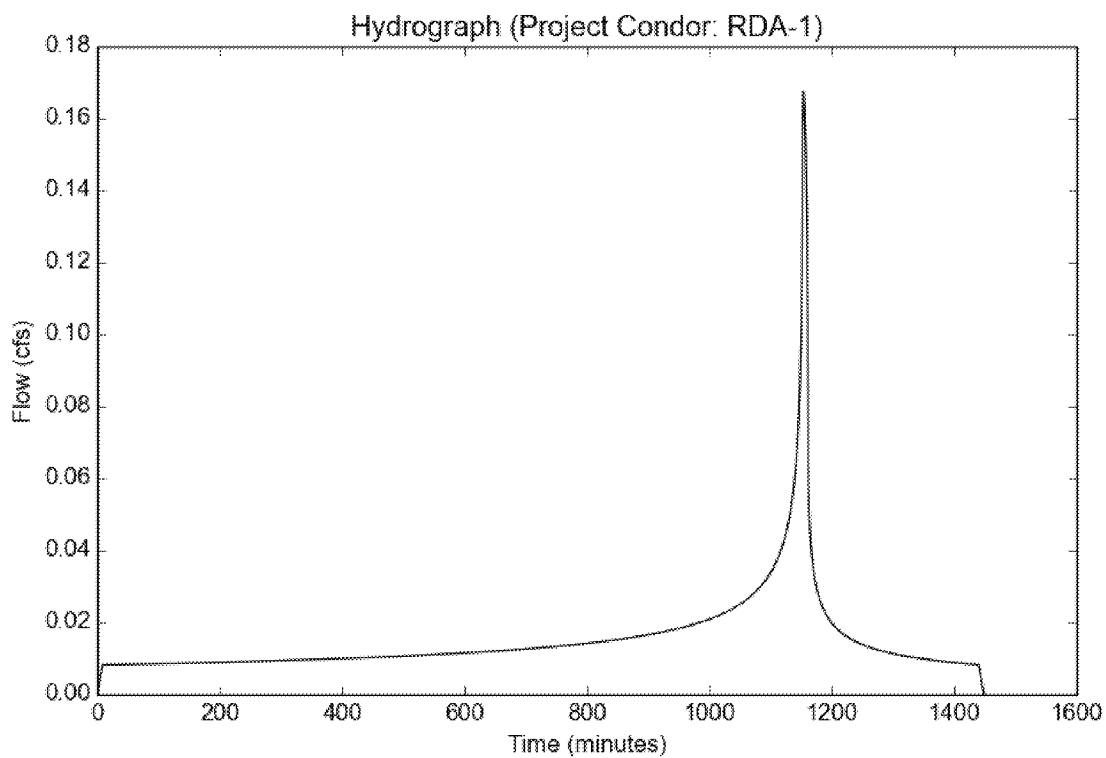

## Peak Flow Hydrologic Analysis


File location: M:/17001/Eng/17001/Hm/LID/Project Condor Report.pdf  
Version: HydroCalc 1.0.3

### Input Parameters

|                                     |                       |
|-------------------------------------|-----------------------|
| Project Name                        | Project Condor        |
| Subarea ID                          | RDA-2                 |
| Area (ac)                           | 0.41                  |
| Flow Path Length (ft)               | 160.0                 |
| Flow Path Slope (vft/hft)           | 0.02                  |
| 85th Percentile Rainfall Depth (in) | 1.05                  |
| Percent Impervious                  | 0.95                  |
| Soil Type                           | 13                    |
| Design Storm Frequency              | 85th percentile storm |
| Fire Factor                         | 0                     |
| LID                                 | True                  |

### Output Results

|   |           |
|---|-----------|
| Modeled (85th percentile storm) Rainfall Depth (in) | 1.05      |
| Peak Intensity (in/hr)                              | 0.4523    |
| Undeveloped Runoff Coefficient (Cu)                 | 0.1       |
| Developed Runoff Coefficient (Cd)                   | 0.86      |
| Time of Concentration (min)                         | 10.0      |
| Clear Peak Flow Rate (cfs)                          | 0.1595    |
| Burned Peak Flow Rate (cfs)                         | 0.1595    |
| 24-Hr Clear Runoff Volume (ac-ft)                   | 0.0306    |
| 24-Hr Clear Runoff Volume (cu-ft)                   | 1332.8297 |

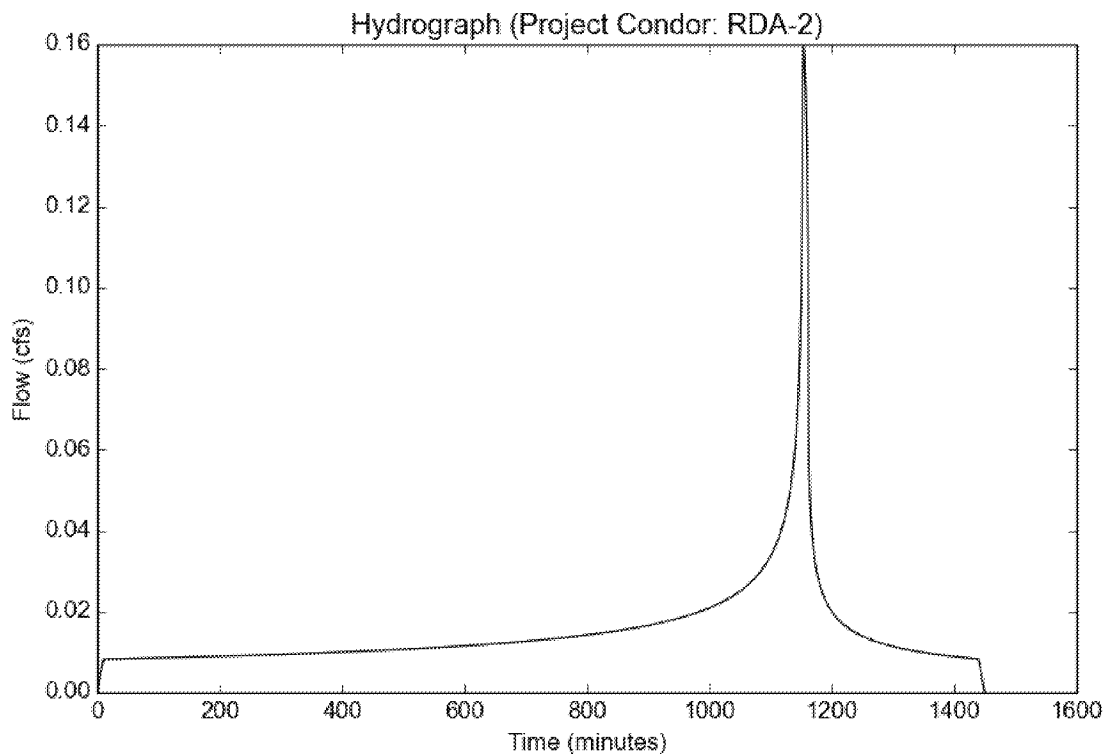

## Peak Flow Hydrologic Analysis


File location: M:/17001/Eng/17001/Hm/LID/Project Condor Report.pdf  
Version: HydroCalc 1.0.3

### Input Parameters

|                                     |                       |
|-------------------------------------|-----------------------|
| Project Name                        | Project Condor        |
| Subarea ID                          | RDA-3                 |
| Area (ac)                           | 0.16                  |
| Flow Path Length (ft)               | 120.0                 |
| Flow Path Slope (vft/hft)           | 0.02                  |
| 85th Percentile Rainfall Depth (in) | 1.05                  |
| Percent Impervious                  | 0.95                  |
| Soil Type                           | 13                    |
| Design Storm Frequency              | 85th percentile storm |
| Fire Factor                         | 0                     |
| LID                                 | True                  |

### Output Results

|   |          |
|---|----------|
| Modeled (85th percentile storm) Rainfall Depth (in) | 1.05     |
| Peak Intensity (in/hr)                              | 0.5023   |
| Undeveloped Runoff Coefficient (Cu)                 | 0.1      |
| Developed Runoff Coefficient (Cd)                   | 0.86     |
| Time of Concentration (min)                         | 8.0      |
| Clear Peak Flow Rate (cfs)                          | 0.0691   |
| Burned Peak Flow Rate (cfs)                         | 0.0691   |
| 24-Hr Clear Runoff Volume (ac-ft)                   | 0.0119   |
| 24-Hr Clear Runoff Volume (cu-ft)                   | 520.1284 |

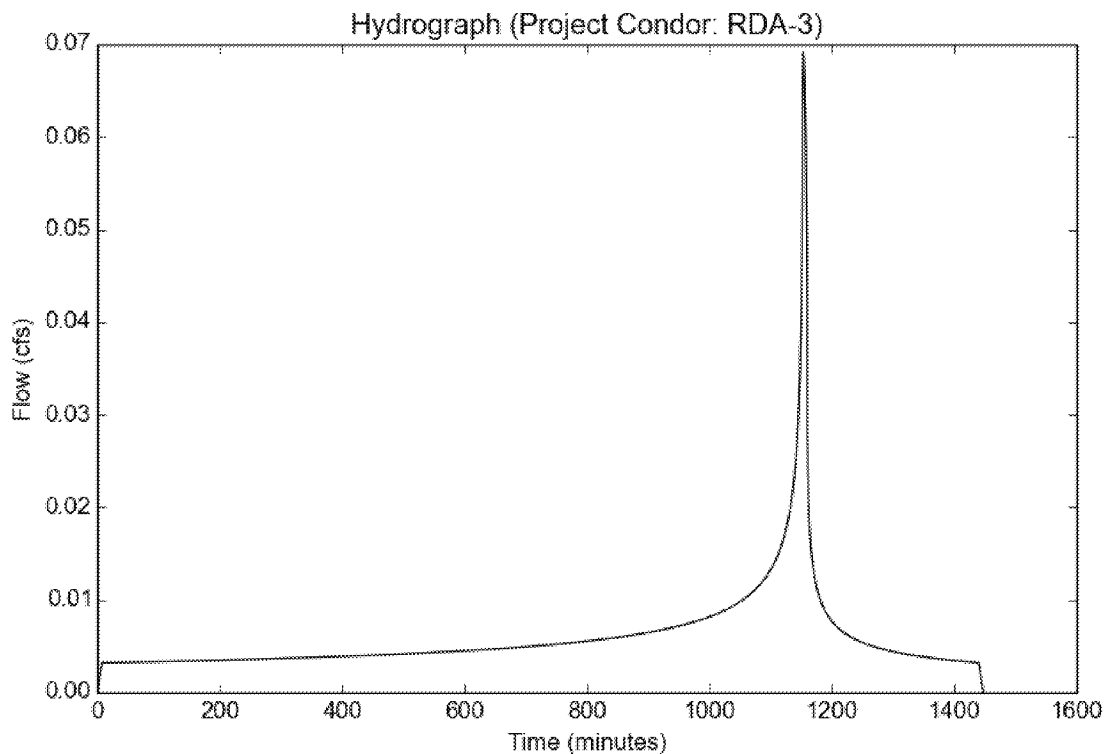

## Peak Flow Hydrologic Analysis


File location: M:/17001/Eng/17001/Hm/LID/Project Condor Report.pdf  
Version: HydroCalc 1.0.3

### Input Parameters

|                                     |                       |
|-------------------------------------|-----------------------|
| Project Name                        | Project Condor        |
| Subarea ID                          | RDA-4A                |
| Area (ac)                           | 3.55                  |
| Flow Path Length (ft)               | 480.0                 |
| Flow Path Slope (vft/hft)           | 0.02                  |
| 85th Percentile Rainfall Depth (in) | 1.05                  |
| Percent Impervious                  | 0.95                  |
| Soil Type                           | 13                    |
| Design Storm Frequency              | 85th percentile storm |
| Fire Factor                         | 0                     |
| LID                                 | True                  |

### Output Results

|   |            |
|---|------------|
| Modeled (85th percentile storm) Rainfall Depth (in) | 1.05       |
| Peak Intensity (in/hr)                              | 0.3265     |
| Undeveloped Runoff Coefficient (Cu)                 | 0.1        |
| Developed Runoff Coefficient (Cd)                   | 0.86       |
| Time of Concentration (min)                         | 20.0       |
| Clear Peak Flow Rate (cfs)                          | 0.9969     |
| Burned Peak Flow Rate (cfs)                         | 0.9969     |
| 24-Hr Clear Runoff Volume (ac-ft)                   | 0.2649     |
| 24-Hr Clear Runoff Volume (cu-ft)                   | 11540.3985 |

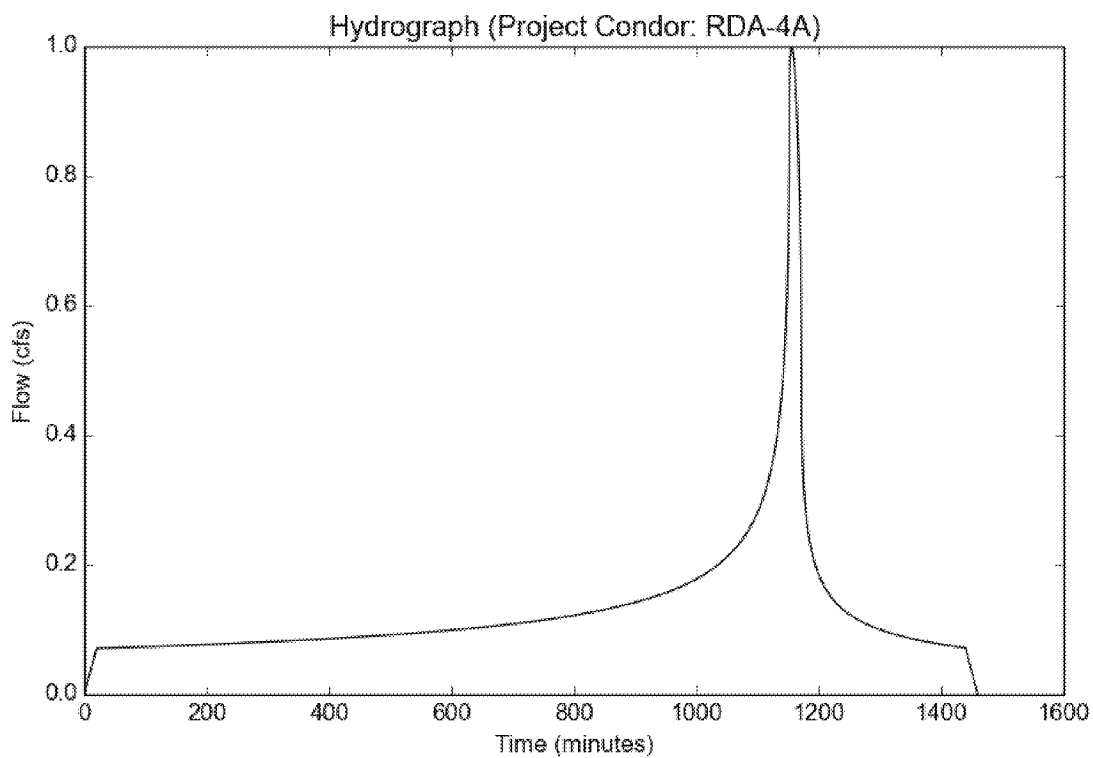

## Peak Flow Hydrologic Analysis


File location: M:/17001/Eng/17001/Hm/LID/Project Condor Report.pdf  
Version: HydroCalc 1.0.3

### Input Parameters

|                                     |                       |
|-------------------------------------|-----------------------|
| Project Name                        | Project Condor        |
| Subarea ID                          | RDA-4B                |
| Area (ac)                           | 3.55                  |
| Flow Path Length (ft)               | 390.0                 |
| Flow Path Slope (vft/hft)           | 0.02                  |
| 85th Percentile Rainfall Depth (in) | 1.05                  |
| Percent Impervious                  | 0.95                  |
| Soil Type                           | 13                    |
| Design Storm Frequency              | 85th percentile storm |
| Fire Factor                         | 0                     |
| LID                                 | True                  |

### Output Results

|   |            |
|---|------------|
| Modeled (85th percentile storm) Rainfall Depth (in) | 1.05       |
| Peak Intensity (in/hr)                              | 0.3431     |
| Undeveloped Runoff Coefficient (Cu)                 | 0.1        |
| Developed Runoff Coefficient (Cd)                   | 0.86       |
| Time of Concentration (min)                         | 18.0       |
| Clear Peak Flow Rate (cfs)                          | 1.0475     |
| Burned Peak Flow Rate (cfs)                         | 1.0475     |
| 24-Hr Clear Runoff Volume (ac-ft)                   | 0.2649     |
| 24-Hr Clear Runoff Volume (cu-ft)                   | 11540.3873 |

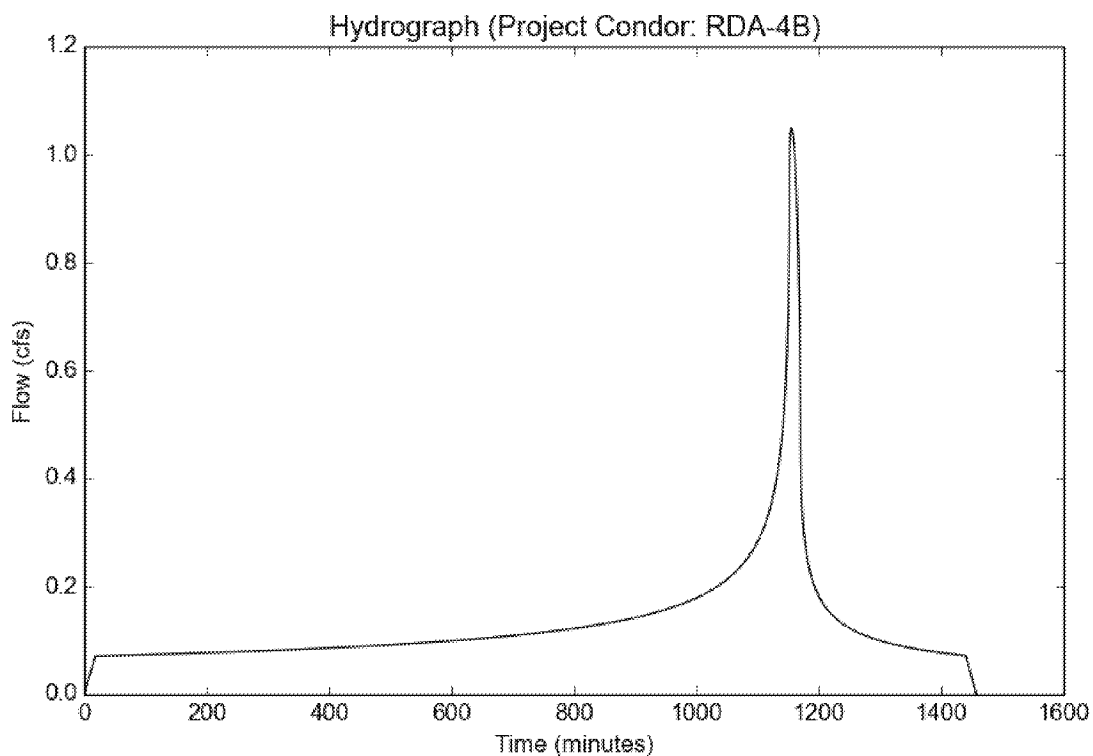

## Peak Flow Hydrologic Analysis


File location: M:/17001/Eng/17001/Hm/LID/Project Condor Report.pdf  
Version: HydroCalc 1.0.3

### Input Parameters

|                                     |                       |
|-------------------------------------|-----------------------|
| Project Name                        | Project Condor        |
| Subarea ID                          | RDA-5                 |
| Area (ac)                           | 1.55                  |
| Flow Path Length (ft)               | 330.0                 |
| Flow Path Slope (vft/hft)           | 0.02                  |
| 85th Percentile Rainfall Depth (in) | 1.05                  |
| Percent Impervious                  | 0.95                  |
| Soil Type                           | 13                    |
| Design Storm Frequency              | 85th percentile storm |
| Fire Factor                         | 0                     |
| LID                                 | True                  |

### Output Results

|   |           |
|---|-----------|
| Modeled (85th percentile storm) Rainfall Depth (in) | 1.05      |
| Peak Intensity (in/hr)                              | 0.3626    |
| Undeveloped Runoff Coefficient (Cu)                 | 0.1       |
| Developed Runoff Coefficient (Cd)                   | 0.86      |
| Time of Concentration (min)                         | 16.0      |
| Clear Peak Flow Rate (cfs)                          | 0.4834    |
| Burned Peak Flow Rate (cfs)                         | 0.4834    |
| 24-Hr Clear Runoff Volume (ac-ft)                   | 0.1157    |
| 24-Hr Clear Runoff Volume (cu-ft)                   | 5038.7563 |

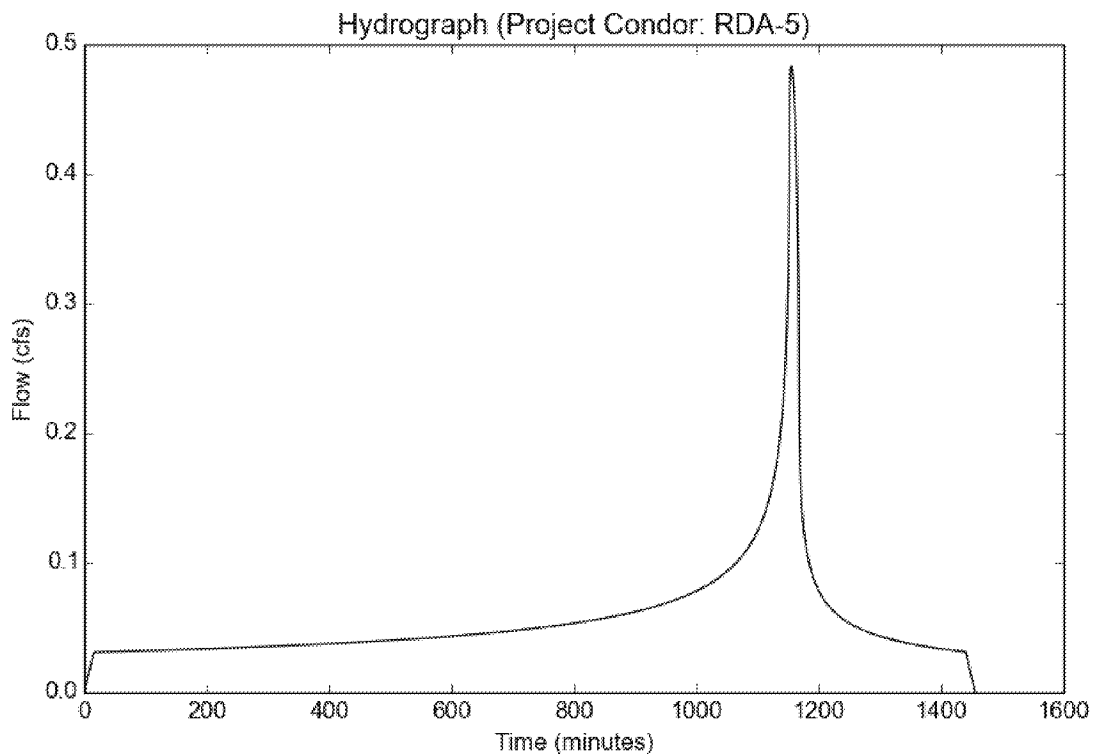

## Peak Flow Hydrologic Analysis


File location: M:/17001/Eng/17001/Hm/LID/Project Condor Report.pdf  
Version: HydroCalc 1.0.3

### Input Parameters

|                                     |                       |
|-------------------------------------|-----------------------|
| Project Name                        | Project Condor        |
| Subarea ID                          | RDA-6A                |
| Area (ac)                           | 1.83                  |
| Flow Path Length (ft)               | 310.0                 |
| Flow Path Slope (vft/hft)           | 0.02                  |
| 85th Percentile Rainfall Depth (in) | 1.05                  |
| Percent Impervious                  | 0.95                  |
| Soil Type                           | 13                    |
| Design Storm Frequency              | 85th percentile storm |
| Fire Factor                         | 0                     |
| LID                                 | True                  |

### Output Results

|   |           |
|---|-----------|
| Modeled (85th percentile storm) Rainfall Depth (in) | 1.05      |
| Peak Intensity (in/hr)                              | 0.3738    |
| Undeveloped Runoff Coefficient (Cu)                 | 0.1       |
| Developed Runoff Coefficient (Cd)                   | 0.86      |
| Time of Concentration (min)                         | 15.0      |
| Clear Peak Flow Rate (cfs)                          | 0.5883    |
| Burned Peak Flow Rate (cfs)                         | 0.5883    |
| 24-Hr Clear Runoff Volume (ac-ft)                   | 0.1366    |
| 24-Hr Clear Runoff Volume (cu-ft)                   | 5948.9809 |

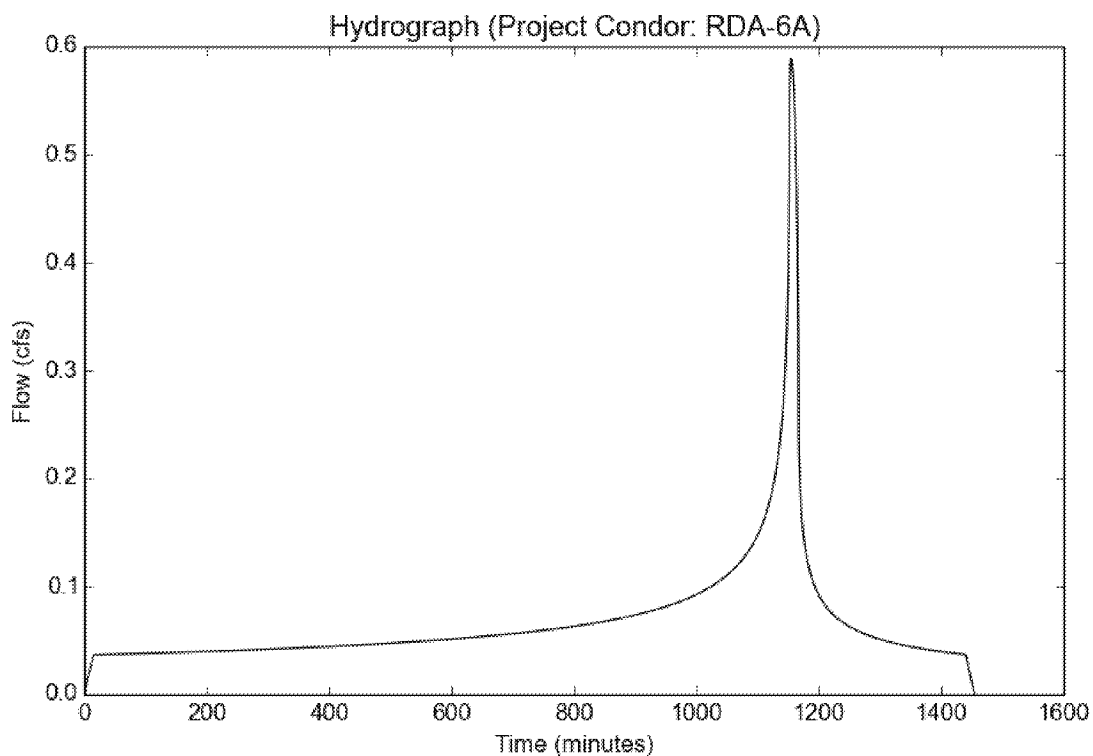



## Peak Flow Hydrologic Analysis


File location: M:/17001/Eng/17001/Hm/LID/Project Condor Report.pdf  
Version: HydroCalc 1.0.3

### Input Parameters

|                                     |                       |
|-------------------------------------|-----------------------|
| Project Name                        | Project Condor        |
| Subarea ID                          | RDA-6B                |
| Area (ac)                           | 0.91                  |
| Flow Path Length (ft)               | 190.0                 |
| Flow Path Slope (vft/hft)           | 0.02                  |
| 85th Percentile Rainfall Depth (in) | 1.05                  |
| Percent Impervious                  | 0.95                  |
| Soil Type                           | 13                    |
| Design Storm Frequency              | 85th percentile storm |
| Fire Factor                         | 0                     |
| LID                                 | True                  |

### Output Results

|   |           |
|---|-----------|
| Modeled (85th percentile storm) Rainfall Depth (in) | 1.05      |
| Peak Intensity (in/hr)                              | 0.4325    |
| Undeveloped Runoff Coefficient (Cu)                 | 0.1       |
| Developed Runoff Coefficient (Cd)                   | 0.86      |
| Time of Concentration (min)                         | 11.0      |
| Clear Peak Flow Rate (cfs)                          | 0.3384    |
| Burned Peak Flow Rate (cfs)                         | 0.3384    |
| 24-Hr Clear Runoff Volume (ac-ft)                   | 0.0679    |
| 24-Hr Clear Runoff Volume (cu-ft)                   | 2958.2325 |

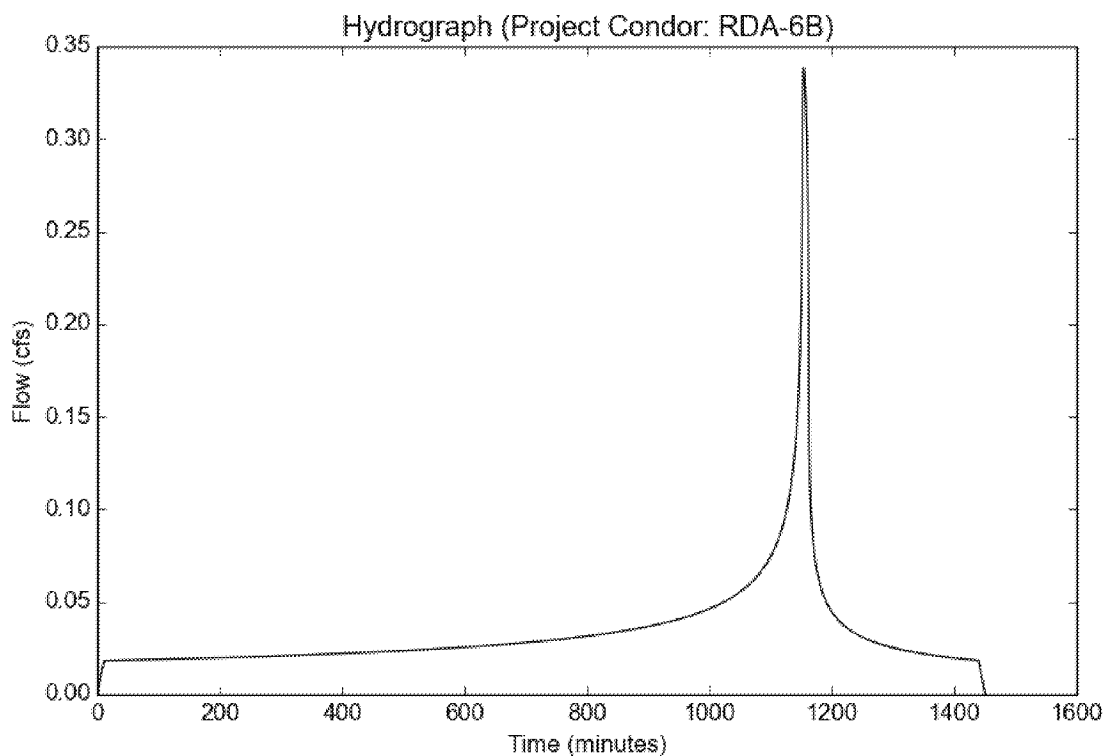

## Peak Flow Hydrologic Analysis


File location: M:/17001/Eng/17001/Hm/LID/Project Condor Report.pdf  
Version: HydroCalc 1.0.3


### Input Parameters

|                                     |                       |
|-------------------------------------|-----------------------|
| Project Name                        | Project Condor        |
| Subarea ID                          | RDA-6C                |
| Area (ac)                           | 1.84                  |
| Flow Path Length (ft)               | 320.0                 |
| Flow Path Slope (vft/hft)           | 0.02                  |
| 85th Percentile Rainfall Depth (in) | 1.05                  |
| Percent Impervious                  | 0.95                  |
| Soil Type                           | 13                    |
| Design Storm Frequency              | 85th percentile storm |
| Fire Factor                         | 0                     |
| LID                                 | True                  |

### Output Results

|   |          |
|---|----------|
| Modeled (85th percentile storm) Rainfall Depth (in) | 1.05     |
| Peak Intensity (in/hr)                              | 0.3738   |
| Undeveloped Runoff Coefficient (Cu)                 | 0.1      |
| Developed Runoff Coefficient (Cd)                   | 0.86     |
| Time of Concentration (min)                         | 15.0     |
| Clear Peak Flow Rate (cfs)                          | 0.5915   |
| Burned Peak Flow Rate (cfs)                         | 0.5915   |
| 24-Hr Clear Runoff Volume (ac-ft)                   | 0.1373   |
| 24-Hr Clear Runoff Volume (cu-ft)                   | 5981.489 |

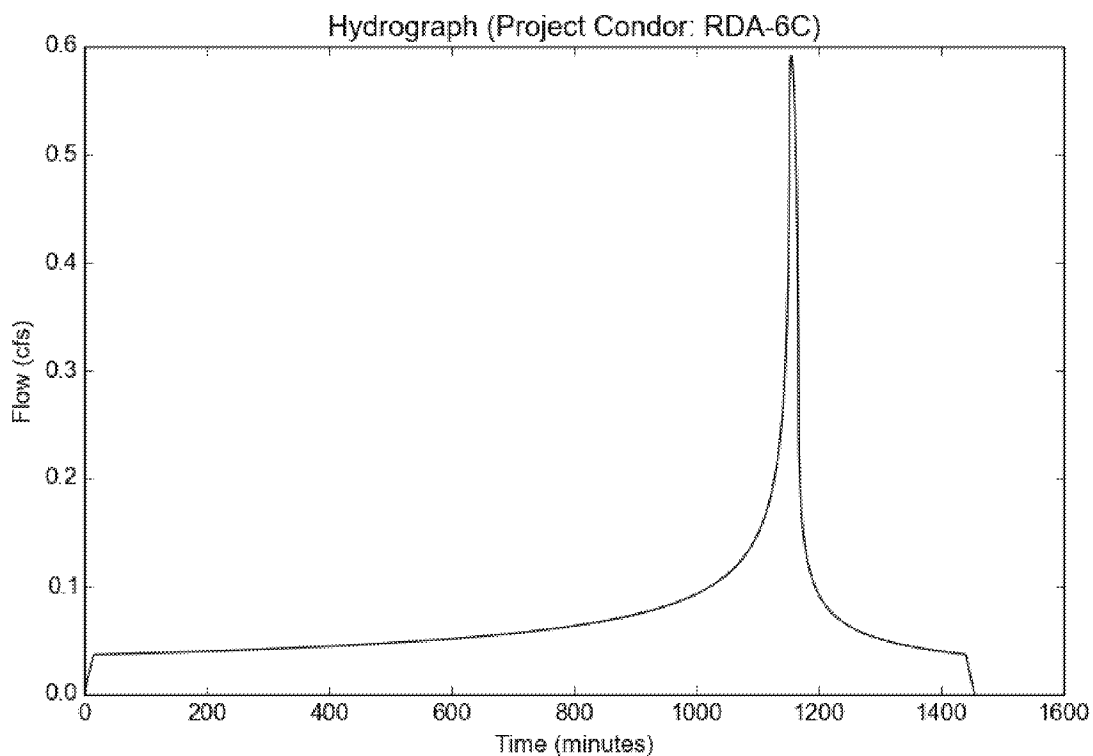



## **Appendix C**



### ***Bio-Filtration Sizing Calculations***



**LID SUMMARY TABLE****AREA**

| <b>SUBAREA</b> | <b>SF</b> | <b>ACRE</b> | <b>Vm</b> | <b>Vdesign</b> | <b>Qpm</b> | <b>Amin</b> | <b>BMP Provided</b> |
|----------------|-----------|-------------|-----------|----------------|------------|-------------|---------------------|
| DA-1           | 90,537    | 2.08        | 6447      | 9671           | 0.5852     | 3,868       | PLANTER B           |
| DA-2           | 33,854    | 0.78        | 2418      | 3627           | 0.3040     | 1,451       | PLANTER B           |
| DA-3           | 43,992    | 1.01        | 3131      | 4697           | 0.3936     | 1,879       | PLANTER B           |
| DA-4           | 18,343    | 0.42        | 1302      | 1953           | 0.1558     | 68          | FILTERRA            |
| DA-5           | 39,116    | 0.90        | 2790      | 4185           | 0.3192     | 143         | FILTERRA            |
| DA-6           | 45,775    | 1.05        | 3255      | 4883           | 0.4325     | 179         | FILTERRA            |
| DA-7           | 41,333    | 0.95        | 2945      | 4418           | 0.2382     | 130         | FILTERRA            |
| DA-8           | 92,868    | 2.13        | 6602      | 9903           | 0.4714     | 275         | FILTERRA            |
| DA-9           | 25,185    | 0.58        | 1798      | 2697           | 0.1398     | 78          | FILTERRA            |
| DA-10          | 39,073    | 0.90        | 2790      | 4185           | 0.2951     | 138         | FILTERRA            |
| DA-11          | 12,631    | 0.29        | 899       | 1349           | 0.0889     | 43          | FILTERRA            |
| RDA-1          | 17,696    | 0.41        | 1333      | 2000           | 0.1676     | 800         | PLANTER A           |
| RDA-2          | 17,985    | 0.41        | 1333      | 2000           | 0.1595     | 800         | PLANTER A           |
| RDA-3          | 6,815     | 0.16        | 520       | 780            | 0.0691     | 312         | PLANTER A           |
| RDA-4A         | 154,674   | 3.55        | 11540     | 17310          | 0.9969     | 6,924       | PLANTER A           |
| RDA-4B         | 154,692   | 3.55        | 11540     | 17310          | 1.0475     | 6,924       | PLANTER A           |
| RDA-5          | 67,342    | 1.55        | 5039      | 7559           | 0.4834     | 3,023       | PLANTER A           |
| RDA-6A         | 79,803    | 1.83        | 5949      | 8924           | 0.5883     | 3,569       | PLANTER A           |
| RDA-6B         | 39,726    | 0.91        | 2958      | 4437           | 0.3384     | 1,775       | PLANTER A           |
| RDA-6C         | 80,006    | 1.84        | 5981      | 8972           | 0.5915     | 3,589       | PLANTER A           |

# PROJECT CONDOR

## INGLEWOOD, CA

### LID CALCULATIONS

#### DRAINAGE AREA

#### PLANTER

DA-1

P1

|                          |        |    |
|--------------------------|--------|----|
| Site area:               | 90,537 | sf |
| Impervious               | 0.90   | %  |
| 85th Percentile:         | 1.05   | in |
| Volume ( $V_m$ ):        | 6447   | cf |
| $V_{design} = V_m * 1.5$ | 9671   | cf |

Note: For Flow Through Planters

$$V_{design} = 1.5 * V_m$$

| Sizing                       |       | Units   |
|------------------------------|-------|---------|
| $K_{sat}$                    | 12    | in/hour |
| FS                           | 2     | -       |
| $K_{sat,des} = (K_{sat}/FS)$ | 6     | in/hour |
| T                            | 3     | hrs     |
| $H_{planter}$                | 51    | in      |
| $d_p$                        | 12    | in      |
| $A_{min} =$                  | 3,868 | sf      |

$$A_{min} = \frac{V_{design}}{\frac{T * K_{sat,des} + d_p}{12}}$$

T= Drawdown Time

$H_{planter}$  = Planter Height

$d_p$  = Ponding Depth

$A_{min}$  = Minimum Area Required

# PROJECT CONDOR

## INGLEWOOD, CA

### LID CALCULATIONS

#### DRAINAGE AREA

#### PLANTER

DA-2

P2

|   |        |    |
|---|--------|----|
| Site area:                                | 33,854 | sf |
| Impervious                                | 0.90   | %  |
| 85th Percentile:                          | 1.05   | in |
| Volume (V <sub>m</sub> ):                 | 2418   | cf |
| V <sub>design</sub> = V <sub>m</sub> *1.5 | 3627   | cf |

Note: For Flow Through Planters

$$V_{design} = 1.5 * V_m$$

| Sizing  |         | Units   |
|---|---------|---------|
| K <sub>sat</sub>                              | 12      | in/hour |
| FS  | 2       | -       |
| K <sub>sat,des</sub> = (K <sub>sat</sub> /FS) | 6       | in/hour |
| T   | 3       | hrs     |
| H <sub>planter</sub>                          | 51      | in      |
| d <sub>p</sub>                                | 12      | in      |
| A <sub>min</sub> =                            | 1,450.8 | sf      |

$$A_{min} = \frac{V_{design}}{\frac{T * K_{sat,des} + d_p}{12}}$$

T= Drawdown Time

H<sub>planter</sub> = Planter Height

d<sub>p</sub> = Ponding Depth

A<sub>min</sub> = Minimum Area Required

# PROJECT CONDOR

## INGLEWOOD, CA

### LID CALCULATIONS

#### DRAINAGE AREA

#### PLANTER

DA-3

P3

|                          |        |    |
|--------------------------|--------|----|
| Site area:               | 43,992 | sf |
| Impervious               | 0.90   | %  |
| 85th Percentile:         | 1.05   | in |
| Volume ( $V_m$ ):        | 3131   | cf |
| $V_{design} = V_m * 1.5$ | 4697   | cf |

Note: For Flow Through Planters

$$V_{design} = 1.5 * V_m$$

| Sizing                       |                | Units   |
|------------------------------|----------------|---------|
| $K_{sat}$                    | 12             | in/hour |
| FS                           | 2              | -       |
| $K_{sat,des} = (K_{sat}/FS)$ | 6              | in/hour |
| T                            | 3              | hrs     |
| $H_{planter}$                | 57             | in      |
| $d_p$                        | 12             | in      |
| $A_{min} =$                  | <b>1,878.6</b> | sf      |

$$A_{min} = \frac{V_{design}}{\frac{T * K_{sat,des} + d_p}{12}}$$

T= Drawdown Time

$H_{planter}$  = Planter Height

$d_p$  = Ponding Depth

$A_{min}$  = Minimum Area Required

# PROJECT CONDOR

## INGLEWOOD, CA

### LID CALCULATIONS

#### DRAINAGE AREA

#### PLANTER

RDA-1

P4

|                          |        |    |
|--------------------------|--------|----|
| Site area:               | 17,696 | sf |
| Impervious               | 0.95   | %  |
| 85th Percentile:         | 1.05   | in |
| Volume ( $V_m$ ):        | 1333   | cf |
| $V_{design} = V_m * 1.5$ | 2000   | cf |

Note: For Flow Through Planters

$$V_{design} = 1.5 * V_m$$

| Sizing                       |       | Units   |
|------------------------------|-------|---------|
| $K_{sat}$                    | 12    | in/hour |
| FS                           | 2     | -       |
| $K_{sat,des} = (K_{sat}/FS)$ | 6     | in/hour |
| T                            | 3     | hrs     |
| $H_{planter}$                | 51    | in      |
| $d_p$                        | 12    | in      |
| $A_{min} =$                  | 799.8 | sf      |

$$A_{min} = \frac{V_{design}}{\frac{T * K_{sat,des} + d_p}{12}}$$

T= Drawdown Time

$H_{planter}$  = Planter Height

$d_p$  = Ponding Depth

$A_{min}$  = Minimum Area Required



# PROJECT CONDOR

## INGLEWOOD, CA

### LID CALCULATIONS

#### DRAINAGE AREA

#### PLANTER

RDA-2

P5

|                          |        |    |
|--------------------------|--------|----|
| Site area:               | 17,985 | sf |
| Impervious               | 0.95   | %  |
| 85th Percentile:         | 1.05   | in |
| Volume ( $V_m$ ):        | 1333   | cf |
| $V_{design} = V_m * 1.5$ | 2000   | cf |

Note: For Flow Through Planters

$$V_{design} = 1.5 * V_m$$

| Sizing                       |       | Units   |
|------------------------------|-------|---------|
| $K_{sat}$                    | 12    | in/hour |
| FS                           | 2     | -       |
| $K_{sat,des} = (K_{sat}/FS)$ | 6     | in/hour |
| T                            | 3     | hrs     |
| $H_{planter}$                | 57    | in      |
| $d_p$                        | 12    | in      |
| $A_{min} =$                  | 799.8 | sf      |

$$A_{min} = \frac{V_{design}}{\frac{T * K_{sat,des} + d_p}{12}}$$

T= Drawdown Time

$H_{planter}$  = Planter Height

$d_p$  = Ponding Depth

$A_{min}$  = Minimum Area Required

# PROJECT CONDOR

INGLEWOOD, CA

## LID CALCULATIONS

### DRAINAGE AREA

### PLANTER

RDA-3

P6

|                          |       |    |
|--------------------------|-------|----|
| Site area:               | 6,815 | sf |
| Impervious               | 0.95  | %  |
| 85th Percentile:         | 1.05  | in |
| Volume ( $V_m$ ):        | 520   | cf |
| $V_{design} = V_m * 1.5$ | 780   | cf |

Note: For Flow Through Planters

$$V_{design} = 1.5 * V_m$$

| Sizing                       |              | Units   |
|------------------------------|--------------|---------|
| $K_{sat}$                    | 12           | in/hour |
| FS                           | 2            | -       |
| $K_{sat,des} = (K_{sat}/FS)$ | 6            | in/hour |
| T                            | 3            | hrs     |
| $H_{planter}$                | 57           | in      |
| $d_p$                        | 12           | in      |
| $A_{min} =$                  | <b>312.0</b> | sf      |

$$A_{min} = \frac{V_{design}}{\frac{T * K_{sat,des} + d_p}{12}}$$

T= Drawdown Time

$H_{planter}$  = Planter Height

$d_p$  = Ponding Depth

$A_{min}$  = Minimum Area Required

# PROJECT CONDOR

INGLEWOOD, CA

## LID CALCULATIONS

### DRAINAGE AREA

### PLANTER

RDA-4A

P7, P8

|                          |         |    |
|--------------------------|---------|----|
| Site area:               | 154,674 | sf |
| Impervious               | 0.95    | %  |
| 85th Percentile:         | 1.05    | in |
| Volume ( $V_m$ ):        | 11540   | cf |
| $V_{design} = V_m * 1.5$ | 17310   | cf |

Note: For Flow Through Planters

$$V_{design} = 1.5 * V_m$$

| Sizing                       |         | Units   |
|------------------------------|---------|---------|
| $K_{sat}$                    | 12      | in/hour |
| FS                           | 2       | -       |
| $K_{sat,des} = (K_{sat}/FS)$ | 6       | in/hour |
| T                            | 3       | hrs     |
| $H_{planter}$                | 51      | in      |
| $d_p$                        | 12      | in      |
| $A_{min} =$                  | 6,924.0 | sf      |

$$A_{min} = \frac{V_{design}}{\frac{T * K_{sat,des} + d_p}{12}}$$

T= Drawdown Time

$H_{planter}$  = Planter Height

$d_p$  = Ponding Depth

$A_{min}$  = Minimum Area Required

# PROJECT CONDOR

## INGLEWOOD, CA

### LID CALCULATIONS

#### DRAINAGE AREA

#### PLANTER

RDA-4B

P11

|                          |         |    |
|--------------------------|---------|----|
| Site area:               | 154,692 | sf |
| Impervious               | 0.95    | %  |
| 85th Percentile:         | 1.05    | in |
| Volume ( $V_m$ ):        | 11540   | cf |
| $V_{design} = V_m * 1.5$ | 17310   | cf |

Note: For Flow Through Planters

$$V_{design} = 1.5 * V_m$$

| Sizing                       |         | Units   |
|------------------------------|---------|---------|
| $K_{sat}$                    | 12      | in/hour |
| FS                           | 2       | -       |
| $K_{sat,des} = (K_{sat}/FS)$ | 6       | in/hour |
| T                            | 3       | hrs     |
| $H_{planter}$                | 51      | in      |
| $d_p$                        | 12      | in      |
| $A_{min} =$                  | 6,924.0 | sf      |

$$A_{min} = \frac{V_{design}}{\frac{T * K_{sat,des} + d_p}{12}}$$

T= Drawdown Time

$H_{planter}$  = Planter Height

$d_p$  = Ponding Depth

$A_{min}$  = Minimum Area Required

# PROJECT CONDOR

INGLEWOOD, CA

## LID CALCULATIONS

### DRAINAGE AREA

### PLANTER

RDA-5

P9, 10

|                          |        |    |
|--------------------------|--------|----|
| Site area:               | 67,342 | sf |
| Impervious               | 0.95   | %  |
| 85th Percentile:         | 1.05   | in |
| Volume ( $V_m$ ):        | 5039   | cf |
| $V_{design} = V_m * 1.5$ | 7559   | cf |

Note: For Flow Through Planters

$$V_{design} = 1.5 * V_m$$

| Sizing                       |         | Units   |
|------------------------------|---------|---------|
| $K_{sat}$                    | 12      | in/hour |
| FS                           | 2       | -       |
| $K_{sat,des} = (K_{sat}/FS)$ | 6       | in/hour |
| T                            | 3       | hrs     |
| $H_{planter}$                | 51      | in      |
| $d_p$                        | 12      | in      |
| $A_{min} =$                  | 3,023.4 | sf      |

$$A_{min} = \frac{V_{design}}{\frac{T * K_{sat,des} + d_p}{12}}$$

T= Drawdown Time

$H_{planter}$  = Planter Height

$d_p$  = Ponding Depth

$A_{min}$  = Minimum Area Required

# PROJECT CONDOR

## INGLEWOOD, CA

### LID CALCULATIONS

#### DRAINAGE AREA

#### PLANTER

RDA-6A

P12

|                          |        |    |
|--------------------------|--------|----|
| Site area:               | 79,803 | sf |
| Impervious               | 0.95   | %  |
| 85th Percentile:         | 1.05   | in |
| Volume ( $V_m$ ):        | 5949   | cf |
| $V_{design} = V_m * 1.5$ | 8924   | cf |

Note: For Flow Through Planters

$$V_{design} = 1.5 * V_m$$

| Sizing                       |         | Units   |
|------------------------------|---------|---------|
| $K_{sat}$                    | 12      | in/hour |
| FS                           | 2       | -       |
| $K_{sat,des} = (K_{sat}/FS)$ | 6       | in/hour |
| T                            | 3       | hrs     |
| $H_{planter}$                | 51      | in      |
| $d_p$                        | 12      | in      |
| $A_{min} =$                  | 3,569.4 | sf      |

$$A_{min} = \frac{V_{design}}{\frac{T * K_{sat,des} + d_p}{12}}$$

T= Drawdown Time

$H_{planter}$  = Planter Height

$d_p$  = Ponding Depth

$A_{min}$  = Minimum Area Required

# PROJECT CONDOR

INGLEWOOD, CA

## LID CALCULATIONS

### DRAINAGE AREA

### PLANTER

RDA-6B

P13

|                          |        |    |
|--------------------------|--------|----|
| Site area:               | 39,726 | sf |
| Impervious               | 0.95   | %  |
| 85th Percentile:         | 1.05   | in |
| Volume ( $V_m$ ):        | 2958   | cf |
| $V_{design} = V_m * 1.5$ | 4437   | cf |

Note: For Flow Through Planters

$$V_{design} = 1.5 * V_m$$

| Sizing                       |         | Units   |
|------------------------------|---------|---------|
| $K_{sat}$                    | 12      | in/hour |
| FS                           | 2       | -       |
| $K_{sat,des} = (K_{sat}/FS)$ | 6       | in/hour |
| T                            | 3       | hrs     |
| $H_{planter}$                | 51      | in      |
| $d_p$                        | 12      | in      |
| $A_{min} =$                  | 1,774.8 | sf      |

$$A_{min} = \frac{V_{design}}{\frac{T * K_{sat,des} + d_p}{12}}$$

T= Drawdown Time

$H_{planter}$  = Planter Height

$d_p$  = Ponding Depth

$A_{min}$  = Minimum Area Required

# PROJECT CONDOR

## INGLEWOOD, CA

### LID CALCULATIONS

#### DRAINAGE AREA

#### PLANTER

RDA-6C

P14

|                          |        |    |
|--------------------------|--------|----|
| Site area:               | 80,006 | sf |
| Impervious               | 0.95   | %  |
| 85th Percentile:         | 1.05   | in |
| Volume ( $V_m$ ):        | 5981   | cf |
| $V_{design} = V_m * 1.5$ | 8972   | cf |

Note: For Flow Through Planters

$$V_{design} = 1.5 * V_m$$

| Sizing                       |         | Units   |
|------------------------------|---------|---------|
| $K_{sat}$                    | 12      | in/hour |
| FS                           | 2       | -       |
| $K_{sat,des} = (K_{sat}/FS)$ | 6       | in/hour |
| T                            | 3       | hrs     |
| $H_{planter}$                | 51      | in      |
| $d_p$                        | 12      | in      |
| $A_{min} =$                  | 3,588.6 | sf      |

$$A_{min} = \frac{V_{design}}{\frac{T * K_{sat,des} + d_p}{12}}$$

T= Drawdown Time

$H_{planter}$  = Planter Height

$d_p$  = Ponding Depth

$A_{min}$  = Minimum Area Required





### Filterra Sizing Tool

Applicable in the Area Governed by the Los Angeles County MS4 Permit  
(NPDES PERMIT NO. CAS004001; ORDER NO. R4-2012-0175)

For final design please contact:

**Alexandra Dubrock - Stormwater Consultant**

adubrock@conteches.com

Phone: 949-217-4663

| Contact Information                |                       | Project Information |               |
|------------------------------------|-----------------------|---------------------|---------------|
| Engineer of Record Name            | Robert Dizon          | Project Name        | Condor        |
| Engineer of Record Company Name    | D&D Engineering, Inc. | Project Location    | Inglewood, CA |
| Engineer of Record Office Zip Code | 90301                 | Catchment Name      | DA-4          |

| Drainage Area Inputs                                 |       |                 |
|--|-------|-----------------|
| Drainage Area  | 18343 | ft <sup>2</sup> |
| Runoff coefficient                                   | 0.9   | -               |
| Time of concentration                                | 10    | min             |
| Long term reliable infiltration rate                 | 0.09  | in/hr           |
| 85th percentile, 24-hour depth (see hyperlink below) | 1.05  | in              |

[LA County Rainfall Depth Analysis](#)

| Filterra Configuration (Select from Drop-Down)   | Internal Bypass Pipe |
|--|----------------------|
| Refer to "Filterra Configurations" tab for descriptions and standard details for download. |                      |

| Constants   |                                |                     |
|---|--------------------------------|---------------------|
| LAX Airport 85th Percentile, 24-hour depth (for reference only) | 1.02                           | in                  |
| Filterra hydraulic loading capacity                             | 1.45                           | gpm/ft <sup>2</sup> |
| Outputs   |                                |                     |
| Stormwater Quality Design Volume                                | 1,445                          | ft <sup>3</sup>     |
| Design Rainfall Intensity for Equivalent Long Term Capture      | 0.382                          | in/hr               |
| Site Scaling Factor   | 1.03                           | -                   |
| Stormwater Quality Design Flow Rate                             | 0.15                           | cfs                 |
| Design Alternatives Available                                   | Stand Alone Filterra Permitted |                     |

| Design Recommendations  |                   |                 |
|---|-------------------|-----------------|
| <i>Primary Recommendation - Stand Alone Filterra</i>                |                   |                 |
| Adjusted Filterra Design Intensity                                  | 0.560             | in/hr           |
| Stormwater Quality Design Flow Rate                                 | 0.22              | cfs             |
| Required Filterra Area  | 68                | ft <sup>2</sup> |
| Filterra Model ID   | FTIBP 6x12 / 12x6 |                 |
| <i>Alternative Recommendation - Filterra + Infiltration Storage</i> |                   |                 |
| Required Filterra Area  | 47                | ft <sup>2</sup> |
| Filterra Model ID   | FTIBP 6x8 / 8x6   |                 |
| ChamberMaxx volume  | 194               | ft <sup>3</sup> |
| ChamberMaxx count   | 3                 | chambers        |

To be consistent with approval of the Filterra Bioretention System as an alternative biofiltration specification granted by the Los Angeles Regional Water Quality Control Board on October 9, 2017, Filterra use is subject to the following conditions:

- Filterra systems must be designed and sized following the methodology in Section 4 of the August 2015 report prepared by Geosyntec Consultants, entitled "Filterra Equivalency Analysis and Design Criteria" which is the basis for this design tool.
- Filterra systems use an engineered biofiltration media. Filterra systems, including the engineered biofiltration media, must be provided by the manufacturer. No substitution of materials/media is allowed.
- Filterra is only applicable as an alternative on-site biofiltration design in situations where a project applicant has demonstrated that it is technically infeasible to retain 100 percent of the SWQDV on-site.
- Hydromodification requirements of Section VI.D.7.c.iv of the Los Angeles County MS4 Permit must be considered separately regardless of what type of biofiltration is used.
- Operation and maintenance of Filterra systems must be conducted consistent with the recommendations in the Filterra maintenance manual provided by Contech Engineered Solutions.
- In the area governed by the Los Angeles Region Phase I stormwater permit, conventional biofilters must be sized to treat 1.5X the SWQDV. This results in an average annual capture rate of 93%. Filterra systems sized using this tool will also treat at least 93% of the average annual runoff volume.



### Filterra Sizing Tool

Applicable in the Area Governed by the Los Angeles County MS4 Permit  
(NPDES PERMIT NO. CAS004001; ORDER NO. R4-2012-0175)

For final design please contact:

**Alexandra Dubrock - Stormwater Consultant**

adubrock@conteches.com

Phone: 949-217-4663

| Contact Information                |                       | Project Information |               |
|------------------------------------|-----------------------|---------------------|---------------|
| Engineer of Record Name            | Robert Dizon          | Project Name        | Condor        |
| Engineer of Record Company Name    | D&D Engineering, Inc. | Project Location    | Inglewood, CA |
| Engineer of Record Office Zip Code | 90301                 | Catchment Name      | DA-5          |

| Drainage Area Inputs                                 |       |                 |
|--|-------|-----------------|
| Drainage Area  | 39116 | ft <sup>2</sup> |
| Runoff coefficient                                   | 0.9   | -               |
| Time of concentration                                | 11    | min             |
| Long term reliable infiltration rate                 | 0.09  | in/hr           |
| 85th percentile, 24-hour depth (see hyperlink below) | 1.05  | in              |

[LA County Rainfall Depth Analysis](#)

| Filterra Configuration (Select from Drop-Down)   | Internal Bypass Pipe |
|--|----------------------|
| Refer to "Filterra Configurations" tab for descriptions and standard details for download. |                      |

| Constants   |                                |                     |
|---|--------------------------------|---------------------|
| LAX Airport 85th Percentile, 24-hour depth (for reference only) | 1.02                           | in                  |
| Filterra hydraulic loading capacity                             | 1.45                           | gpm/ft <sup>2</sup> |
| Outputs   |                                |                     |
| Stormwater Quality Design Volume                                | 3,080                          | ft <sup>3</sup>     |
| Design Rainfall Intensity for Equivalent Long Term Capture      | 0.377                          | in/hr               |
| Site Scaling Factor   | 1.03                           | -                   |
| Stormwater Quality Design Flow Rate                             | 0.32                           | cfs                 |
| Design Alternatives Available                                   | Stand Alone Filterra Permitted |                     |

| Design Recommendations                               |          |                 |
|--|----------|-----------------|
| <i>Primary Recommendation - Stand Alone Filterra</i> |          |                 |
| Adjusted Filterra Design Intensity                   | 0.551    | in/hr           |
| Stormwater Quality Design Flow Rate                  | 0.46     | cfs             |
| Required Filterra Area                               | 143      | ft <sup>2</sup> |
| Filterra Model ID                                    | See Note |                 |

Note: Drainage area is too large for single Filterra system. Consider a different Filterra configuration, utilizing multiple structures, or utilizing Filterra Bioscape. Contact Contech for more info.

|   |          |                 |
|---|----------|-----------------|
| <i>Alternative Recommendation - Filterra + Infiltration Storage</i> |          |                 |
| Required Filterra Area  | 98       | ft <sup>2</sup> |
| Filterra Model ID   | See Note |                 |
| ChamberMaxx volume  | 413      | ft <sup>3</sup> |
| ChamberMaxx count   | 6        | chambers        |

Note: Drainage area is too large for single Filterra system. Consider a different Filterra configuration, utilizing multiple structures, or utilizing Filterra Bioscape. Contact Contech for more info.

- To be consistent with approval of the Filterra Bioretention System as an alternative biofiltration specification granted by the Los Angeles Regional Water Quality Control Board on October 9, 2017, Filterra use is subject to the following conditions:
- Filterra systems must be designed and sized following the methodology in Section 4 of the August 2015 report prepared by Geosyntec Consultants, entitled "Filterra Equivalency Analysis and Design Criteria" which is the basis for this design tool.
  - Filterra systems use an engineered biofiltration media. Filterra systems, including the engineered biofiltration media, must be provided by the manufacturer. No substitution of materials/media is allowed.
  - Filterra is only applicable as an alternative on-site biofiltration design in situations where a project applicant has demonstrated that it is technically infeasible to retain 100 percent of the SWQDV on-site.
  - Hydromodification requirements of Section VI.D.7.c.iv of the Los Angeles County MS4 Permit must be considered separately regardless of what type of biofiltration is used.
  - Operation and maintenance of Filterra systems must be conducted consistent with the recommendations in the Filterra maintenance manual provided by Contech Engineered Solutions.
  - In the area governed by the Los Angeles Region Phase I stormwater permit, conventional biofilters must be sized to treat 1.5X the SWQDV. This results in an average annual capture rate of 93%. Filterra systems sized using this tool will also treat at least 93% of the average annual runoff volume.



### Filterra Sizing Tool

Applicable in the Area Governed by the Los Angeles County MS4 Permit  
(NPDES PERMIT NO. CAS004001; ORDER NO. R4-2012-0175)

For final design please contact:

**Alexandra Dubrock - Stormwater Consultant**

adubrock@conteches.com

Phone: 949-217-4663

| Contact Information                |                       | Project Information |               |
|------------------------------------|-----------------------|---------------------|---------------|
| Engineer of Record Name            | Robert Dizon          | Project Name        | Condor        |
| Engineer of Record Company Name    | D&D Engineering, Inc. | Project Location    | Inglewood, CA |
| Engineer of Record Office Zip Code | 90301                 | Catchment Name      | DA-6          |

| Drainage Area Inputs                                 |       |                 |
|--|-------|-----------------|
| Drainage Area  | 45775 | ft <sup>2</sup> |
| Runoff coefficient                                   | 0.9   | -               |
| Time of concentration                                | 8     | min             |
| Long term reliable infiltration rate                 | 0.09  | in/hr           |
| 85th percentile, 24-hour depth (see hyperlink below) | 1.05  | in              |

[LA County Rainfall Depth Analysis](#)

| Filterra Configuration (Select from Drop-Down)   | Internal Bypass Pipe |
|--|----------------------|
| Refer to "Filterra Configurations" tab for descriptions and standard details for download. |                      |

| Constants   |                                       |                     |
|---|---------------------------------------|---------------------|
| LAX Airport 85th Percentile, 24-hour depth (for reference only) | 1.02                                  | in                  |
| Filterra hydraulic loading capacity                             | 1.45                                  | gpm/ft <sup>2</sup> |
| Outputs   |                                       |                     |
| Stormwater Quality Design Volume                                | 3,605                                 | ft <sup>3</sup>     |
| Design Rainfall Intensity for Equivalent Long Term Capture      | 0.392                                 | in/hr               |
| Site Scaling Factor   | 1.03                                  | -                   |
| Stormwater Quality Design Flow Rate                             | 0.39                                  | cfs                 |
| Design Alternatives Available                                   | <b>Stand Alone Filterra Permitted</b> |                     |

#### Design Recommendations

##### Primary Recommendation - Stand Alone Filterra

|                                     |                 |                 |
|-------------------------------------|-----------------|-----------------|
| Adjusted Filterra Design Intensity  | 0.589           | in/hr           |
| Stormwater Quality Design Flow Rate | 0.58            | cfs             |
| Required Filterra Area              | 179             | ft <sup>2</sup> |
| Filterra Model ID                   | <b>See Note</b> |                 |

Note: Drainage area is too large for single Filterra system. Consider a different Filterra configuration, utilizing multiple structures, or utilizing Filterra Bioscape. Contact Contech for more info.

##### Alternative Recommendation - Filterra + Infiltration Storage

|                        |                 |                 |
|------------------------|-----------------|-----------------|
| Required Filterra Area | 120             | ft <sup>2</sup> |
| Filterra Model ID      | <b>See Note</b> |                 |
| ChamberMaxx volume     | 483             | ft <sup>3</sup> |
| ChamberMaxx count      | 7               | chambers        |

Note: Drainage area is too large for single Filterra system. Consider a different Filterra configuration, utilizing multiple structures, or utilizing Filterra Bioscape. Contact Contech for more info.

To be consistent with approval of the Filterra Bioretention System as an alternative biofiltration specification granted by the Los Angeles Regional Water Quality Control Board on October 9, 2017, Filterra use is subject to the following conditions:

- Filterra systems must be designed and sized following the methodology in Section 4 of the August 2015 report prepared by Geosyntec Consultants, entitled "Filterra Equivalency Analysis and Design Criteria" which is the basis for this design tool.
- Filterra systems use an engineered biofiltration media. Filterra systems, including the engineered biofiltration media, must be provided by the manufacturer. No substitution of materials/media is allowed.
- Filterra is only applicable as an alternative on-site biofiltration design in situations where a project applicant has demonstrated that it is technically infeasible to retain 100 percent of the SWQDV on-site.
- Hydromodification requirements of Section VI.D.7.c.iv of the Los Angeles County MS4 Permit must be considered separately regardless of what type of biofiltration is used.
- Operation and maintenance of Filterra systems must be conducted consistent with the recommendations in the Filterra maintenance manual provided by Contech Engineered Solutions.
- In the area governed by the Los Angeles Region Phase I stormwater permit, conventional biofilters must be sized to treat 1.5X the SWQDV. This results in an average annual capture rate of 93%. Filterra systems sized using this tool will also treat at least 93% of the average annual runoff volume.



### Filterra Sizing Tool

Applicable in the Area Governed by the Los Angeles County MS4 Permit  
(NPDES PERMIT NO. CAS004001; ORDER NO. R4-2012-0175)

**For final design please contact:**

**Alexandra Dubrock - Stormwater Consultant**

adubrock@conteches.com

Phone: 949-217-4663

| Contact Information                |                       | Project Information |               |
|------------------------------------|-----------------------|---------------------|---------------|
| Engineer of Record Name            | Robert Dizon          | Project Name        | Condor        |
| Engineer of Record Company Name    | D&D Engineering, Inc. | Project Location    | Inglewood, CA |
| Engineer of Record Office Zip Code | 90301                 | Catchment Name      | DA-7          |

| Drainage Area Inputs                                 |       |                 |
|--|-------|-----------------|
| Drainage Area  | 41333 | ft <sup>2</sup> |
| Runoff coefficient                                   | 0.9   | -               |
| Time of concentration                                | 23    | min             |
| Long term reliable infiltration rate                 | 0.09  | in/hr           |
| 85th percentile, 24-hour depth (see hyperlink below) | 1.05  | in              |

[LA County Rainfall Depth Analysis](#)

| Filterra Configuration (Select from Drop-Down)   | Internal Bypass Curb |
|--|----------------------|
| Refer to "Filterra Configurations" tab for descriptions and standard details for download. |                      |

| Constants   |                                       |                     |
|---|---------------------------------------|---------------------|
| LAX Airport 85th Percentile, 24-hour depth (for reference only) | 1.02                                  | in                  |
| Filterra hydraulic loading capacity                             | 1.45                                  | gpm/ft <sup>2</sup> |
| Outputs   |                                       |                     |
| Stormwater Quality Design Volume                                | 3,255                                 | ft <sup>3</sup>     |
| Design Rainfall Intensity for Equivalent Long Term Capture      | 0.332                                 | in/hr               |
| Site Scaling Factor   | 1.03                                  | -                   |
| Stormwater Quality Design Flow Rate                             | 0.29                                  | cfs                 |
| Design Alternatives Available                                   | <b>Stand Alone Filterra Permitted</b> |                     |

#### Design Recommendations

##### Primary Recommendation - Stand Alone Filterra

|                                     |                 |                 |
|-------------------------------------|-----------------|-----------------|
| Adjusted Filterra Design Intensity  | 0.474           | in/hr           |
| Stormwater Quality Design Flow Rate | 0.42            | cfs             |
| Required Filterra Area              | 130             | ft <sup>2</sup> |
| Filterra Model ID                   | <b>See Note</b> |                 |

Note: Drainage area is too large for single Filterra system. Consider a different Filterra configuration, utilizing multiple structures, or utilizing Filterra Bioscape. Contact Contech for more info.

##### Alternative Recommendation - Filterra + Infiltration Storage

|                        |                 |                 |
|------------------------|-----------------|-----------------|
| Required Filterra Area | 92              | ft <sup>2</sup> |
| Filterra Model ID      | <b>See Note</b> |                 |
| ChamberMaxx volume     | 436             | ft <sup>3</sup> |
| ChamberMaxx count      | 6               | chambers        |

Note: Drainage area is too large for single Filterra system. Consider a different Filterra configuration, utilizing multiple structures, or utilizing Filterra Bioscape. Contact Contech for more info.

To be consistent with approval of the Filterra Bioretention System as an alternative biofiltration specification granted by the Los Angeles Regional Water Quality Control Board on October 9, 2017, Filterra use is subject to the following conditions:

- Filterra systems must be designed and sized following the methodology in Section 4 of the August 2015 report prepared by Geosyntec Consultants, entitled "Filterra Equivalency Analysis and Design Criteria" which is the basis for this design tool.
- Filterra systems use an engineered biofiltration media. Filterra systems, including the engineered biofiltration media, must be provided by the manufacturer. No substitution of materials/media is allowed.
- Filterra is only applicable as an alternative on-site biofiltration design in situations where a project applicant has demonstrated that it is technically infeasible to retain 100 percent of the SWQDV on-site.
- Hydromodification requirements of Section VI.D.7.c.iv of the Los Angeles County MS4 Permit must be considered separately regardless of what type of biofiltration is used.
- Operation and maintenance of Filterra systems must be conducted consistent with the recommendations in the Filterra maintenance manual provided by Contech Engineered Solutions.
- In the area governed by the Los Angeles Region Phase I stormwater permit, conventional biofilters must be sized to treat 1.5X the SWQDV. This results in an average annual capture rate of 93%. Filterra systems sized using this tool will also treat at least 93% of the average annual runoff volume.



### Filterra Sizing Tool

Applicable in the Area Governed by the Los Angeles County MS4 Permit  
(NPDES PERMIT NO. CAS004001; ORDER NO. R4-2012-0175)

For final design please contact:

**Alexandra Dubrock - Stormwater Consultant**

adubrock@conteches.com

Phone: 949-217-4663

| Contact Information                |                       | Project Information |               |
|------------------------------------|-----------------------|---------------------|---------------|
| Engineer of Record Name            | Robert Dizon          | Project Name        | Condor        |
| Engineer of Record Company Name    | D&D Engineering, Inc. | Project Location    | Inglewood, CA |
| Engineer of Record Office Zip Code | 90301                 | Catchment Name      | DA-8          |

| Drainage Area Inputs                                 |       |                 |
|--|-------|-----------------|
| Drainage Area  | 92868 | ft <sup>2</sup> |
| Runoff coefficient                                   | 0.9   | -               |
| Time of concentration                                | 30    | min             |
| Long term reliable infiltration rate                 | 0.09  | in/hr           |
| 85th percentile, 24-hour depth (see hyperlink below) | 1.05  | in              |

[LA County Rainfall Depth Analysis](#)

| Filterra Configuration (Select from Drop-Down)   | Internal Bypass Curb |
|--|----------------------|
| Refer to "Filterra Configurations" tab for descriptions and standard details for download. |                      |

| Constants   |                                |                     |
|---|--------------------------------|---------------------|
| LAX Airport 85th Percentile, 24-hour depth (for reference only) | 1.02                           | in                  |
| Filterra hydraulic loading capacity                             | 1.45                           | gpm/ft <sup>2</sup> |
| Outputs   |                                |                     |
| Stormwater Quality Design Volume                                | 7,313                          | ft <sup>3</sup>     |
| Design Rainfall Intensity for Equivalent Long Term Capture      | 0.320                          | in/hr               |
| Site Scaling Factor   | 1.03                           | -                   |
| Stormwater Quality Design Flow Rate                             | 0.64                           | cfs                 |
| Design Alternatives Available                                   | Stand Alone Filterra Permitted |                     |

#### Design Recommendations

##### Primary Recommendation - Stand Alone Filterra

|                                     |          |                 |
|-------------------------------------|----------|-----------------|
| Adjusted Filterra Design Intensity  | 0.446    | in/hr           |
| Stormwater Quality Design Flow Rate | 0.89     | cfs             |
| Required Filterra Area              | 275      | ft <sup>2</sup> |
| Filterra Model ID                   | See Note |                 |

Note: Drainage area is too large for single Filterra system. Consider a different Filterra configuration, utilizing multiple structures, or utilizing Filterra Bioscape. Contact Contech for more info.

##### Alternative Recommendation - Filterra + Infiltration Storage

|                        |          |                 |
|------------------------|----------|-----------------|
| Required Filterra Area | 198      | ft <sup>2</sup> |
| Filterra Model ID      | See Note |                 |
| ChamberMaxx volume     | 980      | ft <sup>3</sup> |
| ChamberMaxx count      | 13       | chambers        |

Note: Drainage area is too large for single Filterra system. Consider a different Filterra configuration, utilizing multiple structures, or utilizing Filterra Bioscape. Contact Contech for more info.

To be consistent with approval of the Filterra Bioretention System as an alternative biofiltration specification granted by the Los Angeles Regional Water Quality Control Board on October 9, 2017, Filterra use is subject to the following conditions:

- Filterra systems must be designed and sized following the methodology in Section 4 of the August 2015 report prepared by Geosyntec Consultants, entitled "Filterra Equivalency Analysis and Design Criteria" which is the basis for this design tool.
- Filterra systems use an engineered biofiltration media. Filterra systems, including the engineered biofiltration media, must be provided by the manufacturer. No substitution of materials/media is allowed.
- Filterra is only applicable as an alternative on-site biofiltration design in situations where a project applicant has demonstrated that it is technically infeasible to retain 100 percent of the SWQDV on-site.
- Hydromodification requirements of Section VI.D.7.c.iv of the Los Angeles County MS4 Permit must be considered separately regardless of what type of biofiltration is used.
- Operation and maintenance of Filterra systems must be conducted consistent with the recommendations in the Filterra maintenance manual provided by Contech Engineered Solutions.
- In the area governed by the Los Angeles Region Phase I stormwater permit, conventional biofilters must be sized to treat 1.5X the SWQDV. This results in an average annual capture rate of 93%. Filterra systems sized using this tool will also treat at least 93% of the average annual runoff volume.



### Filterra Sizing Tool

Applicable in the Area Governed by the Los Angeles County MS4 Permit  
(NPDES PERMIT NO. CAS004001; ORDER NO. R4-2012-0175)

**For final design please contact:**

**Alexandra Dubrock - Stormwater Consultant**

adubrock@conteches.com

Phone: 949-217-4663

| Contact Information                |                       | Project Information |               |
|------------------------------------|-----------------------|---------------------|---------------|
| Engineer of Record Name            | Robert Dizon          | Project Name        | Condor        |
| Engineer of Record Company Name    | D&D Engineering, Inc. | Project Location    | Inglewood, CA |
| Engineer of Record Office Zip Code | 90301                 | Catchment Name      | DA-9          |

| Drainage Area Inputs                                 |       |                 |
|--|-------|-----------------|
| Drainage Area  | 25185 | ft <sup>2</sup> |
| Runoff coefficient                                   | 0.9   | -               |
| Time of concentration                                | 25    | min             |
| Long term reliable infiltration rate                 | 0.09  | in/hr           |
| 85th percentile, 24-hour depth (see hyperlink below) | 1.05  | in              |

[LA County Rainfall Depth Analysis](#)

| Filterra Configuration (Select from Drop-Down)   | Internal Bypass Curb |
|--|----------------------|
| Refer to "Filterra Configurations" tab for descriptions and standard details for download. |                      |

| Constants   |                                       |                     |
|---|---------------------------------------|---------------------|
| LAX Airport 85th Percentile, 24-hour depth (for reference only) | 1.02                                  | in                  |
| Filterra hydraulic loading capacity                             | 1.45                                  | gpm/ft <sup>2</sup> |
| Outputs   |                                       |                     |
| Stormwater Quality Design Volume                                | 1,983                                 | ft <sup>3</sup>     |
| Design Rainfall Intensity for Equivalent Long Term Capture      | 0.328                                 | in/hr               |
| Site Scaling Factor   | 1.03                                  | -                   |
| Stormwater Quality Design Flow Rate                             | 0.18                                  | cfs                 |
| Design Alternatives Available                                   | <b>Stand Alone Filterra Permitted</b> |                     |

| Design Recommendations  |                          |                 |
|---|--------------------------|-----------------|
| <i>Primary Recommendation - Stand Alone Filterra</i>                |                          |                 |
| Adjusted Filterra Design Intensity                                  | 0.466                    | in/hr           |
| Stormwater Quality Design Flow Rate                                 | 0.25                     | cfs             |
| Required Filterra Area  | 78                       | ft <sup>2</sup> |
| Filterra Model ID   | <b>FTIBC 7x13 / 13x7</b> |                 |
| <i>Alternative Recommendation - Filterra + Infiltration Storage</i> |                          |                 |
| Required Filterra Area  | 55                       | ft <sup>2</sup> |
| Filterra Model ID   | <b>FTIBC 6x10 / 10x6</b> |                 |
| ChamberMaxx volume  | 266                      | ft <sup>3</sup> |
| ChamberMaxx count   | 4                        | chambers        |

To be consistent with approval of the Filterra Bioretention System as an alternative biofiltration specification granted by the Los Angeles Regional Water Quality Control Board on October 9, 2017, Filterra use is subject to the following conditions:

- Filterra systems must be designed and sized following the methodology in Section 4 of the August 2015 report prepared by Geosyntec Consultants, entitled "Filterra Equivalency Analysis and Design Criteria" which is the basis for this design tool.
- Filterra systems use an engineered biofiltration media. Filterra systems, including the engineered biofiltration media, must be provided by the manufacturer. No substitution of materials/media is allowed.
- Filterra is only applicable as an alternative on-site biofiltration design in situations where a project applicant has demonstrated that it is technically infeasible to retain 100 percent of the SWQDV on-site.
- Hydromodification requirements of Section VI.D.7.c.iv of the Los Angeles County MS4 Permit must be considered separately regardless of what type of biofiltration is used.
- Operation and maintenance of Filterra systems must be conducted consistent with the recommendations in the Filterra maintenance manual provided by Contech Engineered Solutions.
- In the area governed by the Los Angeles Region Phase I stormwater permit, conventional biofilters must be sized to treat 1.5X the SWQDV. This results in an average annual capture rate of 93%. Filterra systems sized using this tool will also treat at least 93% of the average annual runoff volume.



### Filterra Sizing Tool

Applicable in the Area Governed by the Los Angeles County MS4 Permit  
(NPDES PERMIT NO. CAS004001; ORDER NO. R4-2012-0175)

**For final design please contact:**

**Alexandra Dubrock - Stormwater Consultant**

adubrock@conteches.com

Phone: 949-217-4663

| Contact Information                |                       | Project Information |               |
|------------------------------------|-----------------------|---------------------|---------------|
| Engineer of Record Name            | Robert Dizon          | Project Name        | Condor        |
| Engineer of Record Company Name    | D&D Engineering, Inc. | Project Location    | Inglewood, CA |
| Engineer of Record Office Zip Code | 90301                 | Catchment Name      | DA-10         |

| Drainage Area Inputs                                 |       |                 |
|--|-------|-----------------|
| Drainage Area  | 39073 | ft <sup>2</sup> |
| Runoff coefficient                                   | 0.9   | -               |
| Time of concentration                                | 13    | min             |
| Long term reliable infiltration rate                 | 0.09  | in/hr           |
| 85th percentile, 24-hour depth (see hyperlink below) | 1.05  | in              |

[LA County Rainfall Depth Analysis](#)

| Filterra Configuration (Select from Drop-Down)   | Internal Bypass Curb |
|--|----------------------|
| Refer to "Filterra Configurations" tab for descriptions and standard details for download. |                      |

| Constants   |                                       |                     |
|---|---------------------------------------|---------------------|
| LAX Airport 85th Percentile, 24-hour depth (for reference only) | 1.02                                  | in                  |
| Filterra hydraulic loading capacity                             | 1.45                                  | gpm/ft <sup>2</sup> |
| Outputs   |                                       |                     |
| Stormwater Quality Design Volume                                | 3,077                                 | ft <sup>3</sup>     |
| Design Rainfall Intensity for Equivalent Long Term Capture      | 0.367                                 | in/hr               |
| Site Scaling Factor   | 1.03                                  | -                   |
| Stormwater Quality Design Flow Rate                             | 0.31                                  | cfs                 |
| Design Alternatives Available                                   | <b>Stand Alone Filterra Permitted</b> |                     |

| Design Recommendations                               |                 |                 |
|--|-----------------|-----------------|
| <i>Primary Recommendation - Stand Alone Filterra</i> |                 |                 |
| Adjusted Filterra Design Intensity                   | 0.532           | in/hr           |
| Stormwater Quality Design Flow Rate                  | 0.45            | cfs             |
| Required Filterra Area                               | 138             | ft <sup>2</sup> |
| Filterra Model ID                                    | <b>See Note</b> |                 |

Note: Drainage area is too large for single Filterra system. Consider a different Filterra configuration, utilizing multiple structures, or utilizing Filterra Bioscape. Contact Contech for more info.

|   |                 |                 |
|---|-----------------|-----------------|
| <i>Alternative Recommendation - Filterra + Infiltration Storage</i> |                 |                 |
| Required Filterra Area  | 96              | ft <sup>2</sup> |
| Filterra Model ID   | <b>See Note</b> |                 |
| ChamberMaxx volume  | 412             | ft <sup>3</sup> |
| ChamberMaxx count   | 6               | chambers        |

Note: Drainage area is too large for single Filterra system. Consider a different Filterra configuration, utilizing multiple structures, or utilizing Filterra Bioscape. Contact Contech for more info.

- To be consistent with approval of the Filterra Bioretention System as an alternative biofiltration specification granted by the Los Angeles Regional Water Quality Control Board on October 9, 2017, Filterra use is subject to the following conditions:
- Filterra systems must be designed and sized following the methodology in Section 4 of the August 2015 report prepared by Geosyntec Consultants, entitled "Filterra Equivalency Analysis and Design Criteria" which is the basis for this design tool.
  - Filterra systems use an engineered biofiltration media. Filterra systems, including the engineered biofiltration media, must be provided by the manufacturer. No substitution of materials/media is allowed.
  - Filterra is only applicable as an alternative on-site biofiltration design in situations where a project applicant has demonstrated that it is technically infeasible to retain 100 percent of the SWQDV on-site.
  - Hydromodification requirements of Section VI.D.7.c.iv of the Los Angeles County MS4 Permit must be considered separately regardless of what type of biofiltration is used.
  - Operation and maintenance of Filterra systems must be conducted consistent with the recommendations in the Filterra maintenance manual provided by Contech Engineered Solutions.
  - In the area governed by the Los Angeles Region Phase I stormwater permit, conventional biofilters must be sized to treat 1.5X the SWQDV. This results in an average annual capture rate of 93%. Filterra systems sized using this tool will also treat at least 93% of the average annual runoff volume.



### Filterra Sizing Tool

Applicable in the Area Governed by the Los Angeles County MS4 Permit  
(NPDES PERMIT NO. CAS004001; ORDER NO. R4-2012-0175)

**For final design please contact:**

**Alexandra Dubrock - Stormwater Consultant**

adubrock@conteches.com

Phone: 949-217-4663

| Contact Information                |                       | Project Information |               |
|------------------------------------|-----------------------|---------------------|---------------|
| Engineer of Record Name            | Robert Dizon          | Project Name        | Condor        |
| Engineer of Record Company Name    | D&D Engineering, Inc. | Project Location    | Inglewood, CA |
| Engineer of Record Office Zip Code | 90301                 | Catchment Name      | DA-11         |

| Drainage Area Inputs                                 |       |                 |
|--|-------|-----------------|
| Drainage Area  | 12631 | ft <sup>2</sup> |
| Runoff coefficient                                   | 0.9   | -               |
| Time of concentration                                | 15    | min             |
| Long term reliable infiltration rate                 | 0.09  | in/hr           |
| 85th percentile, 24-hour depth (see hyperlink below) | 1.05  | in              |

[LA County Rainfall Depth Analysis](#)

| Filterra Configuration (Select from Drop-Down)   | Internal Bypass Curb |
|--|----------------------|
| Refer to "Filterra Configurations" tab for descriptions and standard details for download. |                      |

| Constants   |                                       |                     |
|---|---------------------------------------|---------------------|
| LAX Airport 85th Percentile, 24-hour depth (for reference only) | 1.02                                  | in                  |
| Filterra hydraulic loading capacity                             | 1.45                                  | gpm/ft <sup>2</sup> |
| Outputs   |                                       |                     |
| Stormwater Quality Design Volume                                | 995                                   | ft <sup>3</sup>     |
| Design Rainfall Intensity for Equivalent Long Term Capture      | 0.359                                 | in/hr               |
| Site Scaling Factor   | 1.03                                  | -                   |
| Stormwater Quality Design Flow Rate                             | 0.10                                  | cfs                 |
| Design Alternatives Available                                   | <b>Stand Alone Filterra Permitted</b> |                     |

| Design Recommendations  |                        |                 |
|---|------------------------|-----------------|
| <i>Primary Recommendation - Stand Alone Filterra</i>                |                        |                 |
| Adjusted Filterra Design Intensity                                  | 0.514                  | in/hr           |
| Stormwater Quality Design Flow Rate                                 | 0.14                   | cfs             |
| Required Filterra Area  | 43                     | ft <sup>2</sup> |
| Filterra Model ID   | <b>FTIBC 6x8 / 8x6</b> |                 |
| <i>Alternative Recommendation - Filterra + Infiltration Storage</i> |                        |                 |
| Required Filterra Area  | 31                     | ft <sup>2</sup> |
| Filterra Model ID   | <b>FTIBC 4x8 / 8x4</b> |                 |
| ChamberMaxx volume  | 133                    | ft <sup>3</sup> |
| ChamberMaxx count   | 2                      | chambers        |

To be consistent with approval of the Filterra Bioretention System as an alternative biofiltration specification granted by the Los Angeles Regional Water Quality Control Board on October 9, 2017, Filterra use is subject to the following conditions:

- Filterra systems must be designed and sized following the methodology in Section 4 of the August 2015 report prepared by Geosyntec Consultants, entitled "Filterra Equivalency Analysis and Design Criteria" which is the basis for this design tool.
- Filterra systems use an engineered biofiltration media. Filterra systems, including the engineered biofiltration media, must be provided by the manufacturer. No substitution of materials/media is allowed.
- Filterra is only applicable as an alternative on-site biofiltration design in situations where a project applicant has demonstrated that it is technically infeasible to retain 100 percent of the SWQDV on-site.
- Hydromodification requirements of Section VI.D.7.c.iv of the Los Angeles County MS4 Permit must be considered separately regardless of what type of biofiltration is used.
- Operation and maintenance of Filterra systems must be conducted consistent with the recommendations in the Filterra maintenance manual provided by Contech Engineered Solutions.
- In the area governed by the Los Angeles Region Phase I stormwater permit, conventional biofilters must be sized to treat 1.5X the SWQDV. This results in an average annual capture rate of 93%. Filterra systems sized using this tool will also treat at least 93% of the average annual runoff volume.